




2015 Annual Report

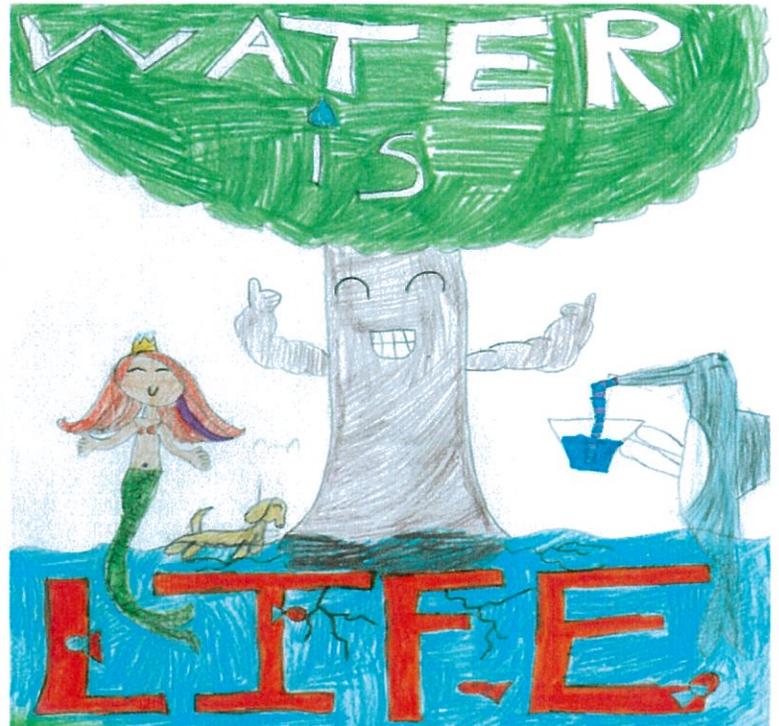

Evanston Public Works Agency
Water Production Bureau
Water and Sewer Utilities
Serving the Community for 141 Years

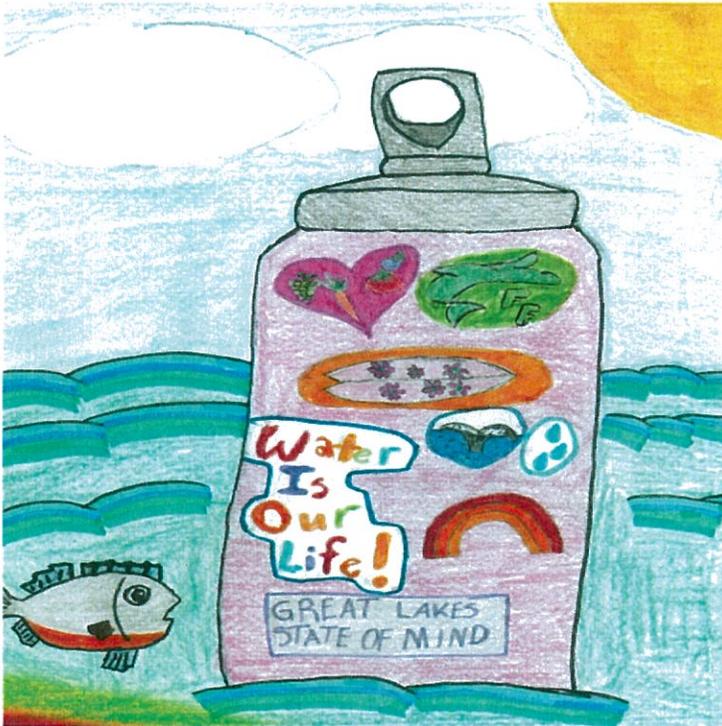

Cover photos, clockwise from top left: National Drinking Water Week 3rd Grade Art Contest Winners - People's Choice Award, Malia G. Schoonyoung, Walker Elementary School, Mayor's Choice Award, Thalia D. Selch, Lincoln Elementary School, Water Spirit Award, Suzie Tyminski, Lincoln Elementary School.



Table of Contents

Introduction

Public Works Agency Annual Accomplishments and Performance Measures	1
Water Treatment Plant Data	5
Water Treatment Schematic	6
Water Works Improvements	7
Service Area and Population	11
Pumpage to Distribution	12
Water Revenues	13
Water Operating and Maintenance Expenses	14
Employee Profile and Safety	15

Pumping

Monthly and Average Daily Pumpage	17
Annual Pumpage	18
Average Daily per Capita Consumption	19
Maximum Day and Peak Hour Pumpage	20
Maximum Pumpage and Demand Days	21
Energy Costs	22

Filtration

Chemical Treatment: Chemicals Used and Cost	25
Annual Chemical Costs	26
Filter Operations	27
Bacteriological Water Analysis	28
Taste & Odor, Turbidity, Temperature and Fluoride	29
Chlorine Residual	30
pH, Alkalinity and Hardness	31
Detected Substances: 2015 Water Quality Data	33
Non-Detected Contaminants: 2015 Water Quality Data	35
Lead and Copper Statement	36
Definitions and General Explanations for Use with Water Quality Data	37

Distribution

Fire Hydrants: System Data and Maintenance	39
Water Distribution System Valves: System Data and Maintenance	40
Water Mains: System Data and Maintenance	41
Water Services: System Data and Maintenance	42
Breakdown of In-House Maintenance Costs	42
Water Main Improvements	43
Leak Detection Program	44
Cross Connection Control	45

Metering

Advanced Metering Infrastructure (AMI) System	47
Transmitter Tower Locations	48
Water Meter Inventory	49
Water Rates for Evanston Customers	49
Water Customer Classes and Metered Usage	50
Water Usage Breakdown for Evanston Customers	51

Sewer

Sewer Revenues	53
Sewer Operating and Maintenance Expenses	54
Major Combined Sewer System	55
Major Relief Sewer System	56
Major Storm Sewer System	57
Sewer Mains: System Data and Maintenance	58
Length of Sewer Mains by Type and Diameter	59
Sewer Structures: System Data and Maintenance	60
Breakdown of In-House Maintenance Costs	61
Sewer Mains Rehabilitated (Lined)	62

Evanston Water and Sewer Utilities Annual Accomplishments and Performance Measures

Introduction

The Evanston Public Works Agency manage water and sewer operations for the City of Evanston. The Water Utility is responsible for operation and maintenance of the Water Treatment Plant, which supplies water to over 365,000 people in Evanston and five other communities. The Water Utility also operates and maintains more than 157 miles of water mains, 2,000 valves, and 1,400 fire hydrants in the Evanston distribution system. This division also manages leak detection and cross connection control programs to minimize water loss and ensure the safety of the community's water supply.

The Sewer Utility is responsible for operation and maintenance of the sewer conveyance systems in Evanston, including a combined sewer system, a relief combined sewer system, and a storm sewer system. These systems are comprised of over 200 miles of sewer mains ranging in size from 6-inch diameter to 120-inch diameter, including over 5,500 manhole structures and over 9,000 drainage structures.

The Public Works Agency also coordinates with ComEd, Nicor, AT&T, and other private utilities on behalf of Evanston residents and businesses to help resolve service issues and improvement needs.

The Department's total FY 2015 budget was approximately \$45.5 million (\$32.1 million Water Fund and \$13.4 million Sewer Fund). Public Works Agency staff includes 54.83 full-time equivalents (FTEs).

Year-to-Year Utilities Department Comparables

	2013	2014	2015
Total Water Pumped (millions of gallons)	13,793	13,428	13,424
Fire Hydrants Repaired or Replaced	197	330	64
Water Main Valves Repaired or Replaced	85	53	71
Water Main Replaced or Rehabilitated (miles)	1.8	1.7	0.89
Large Diameter Sewer Rehabilitated (feet)	8,249	5,356	5,032
Small Diameter Sewer Rehabilitated (feet)	7,829	6,703	6,298
Sewer Mains Inspected (feet of pipe)	101,424	97,347	96,077
Sewer Mains Cleaned (feet of pipe)	187,966	151,091	150,406
Sewer Structures Repaired or Replaced	92	76	91

2015 Major Accomplishments

Maintained High Quality of Services

Became a leader in the public drinking water industry by providing high quality to over 365,000 customers in six communities, including vigilantly monitoring the quality and quantity of water provided to our customers.

Major Water Treatment Facility Improvements

Assured the quality and reliability of the potable water supply by completing major water treatment plant improvements including chemical feed and treatment process reliability improvements, and initiation of finished water storage improvements to address structural deterioration of clearwells built in 1914-1934.

Water Distribution and Metering Improvements

Completed other major distribution system improvements including repair and repainting of the City's two standpipes. The Advanced Meter Information project was completed with the launch of a water management portal, where customers can monitor their real-time water usage, receive leak alerts, and track historical water usage.

Completed Water Supply Expansion Project

Continued to develop and implement a strategy to expand Evanston's wholesale water customer base, including ongoing negotiations with Lincolnwood, as well as continued meetings with other individual communities, the Northwest Water Commission, and Northwest Suburban Municipal Joint Action Water Agency (NSMJAWA) on potential transmission main and water plant improvements under various scenarios.

Main Replacement and Improvement

Improved water distribution system reliability and reduced water loss by expanding on the current water main replacement and water main leak detection programs. Water main replacement was supplemented with water main lining where feasible, to improve upon our historical 1% annual water main renewal rate; the entire distribution system was surveyed for leaks, and will continue to be surveyed on an annual basis.

Coordinated Efficient Project Funding

Coordinated capital improvement projects with the Public Works Department and with TIF District improvement projects to ensure cost-effective and efficient use of capital improvement funding.

Designed and Funded for Large Diameter Sewer Rehabilitation

Performed engineering design and secured state low interest loan funding for two additional large diameter sewer rehabilitation projects scheduled for 2016 and 2017.

Continued Small Diameter Sewer Rehabilitation

Continued the annual small diameter sewer CIPP rehabilitation program at a rate of at least 1% of the combined sewer system rehabilitated per year.

Continued Coordination with Street Resurfacing Program

Coordinated inspection and repair of sewer mains and drainage structures in advance of the street resurfacing program.

Continued Preventative Measures for Sewer Mains

Continued preventative maintenance cleaning and inspection of sewer mains and drainage structures.

Combined and Storm Sewer Inspections

Inspected combined and storm sewer outfalls monthly in accordance with Illinois Environmental Protection Agency regulatory requirements.

Increase Stormwater Management Initiatives

Increased stormwater management initiatives in compliance with requirements for National Pollution Discharge Elimination System (NPDES) permit and Municipal Separate Storm Sewer System (MS4) permit. This includes increased use of green infrastructure measures on public improvement projects, such as permeable pavement and bio infiltration areas.

2016 Major Goals and Initiatives

Maintain High Quality of Service

Be a leader in the public drinking water industry by providing high quality service to over 365,000 customers in six communities, including vigilantly monitoring the quality and quantity of water provided to our customers.

Major Water Treatment Facility Improvements

Assure the quality and reliability of the potable water supply by completing major water treatment plant improvements including chemical feed and treatment process reliability improvements, and initiation of finished water storage improvements to address structural deterioration the City's largest clearwell built in 1934.

Digitalization of Plant Information

Implement a Computerized Maintenance Management System (CMMS) at the water treatment plant to more effectively manage long-term maintenance and replacement of critical treatment plant equipment and structures.

Water Supply Expansion

Continue to develop and implement a strategy to expand Evanston's wholesale water customer base, including ongoing negotiations with Morton Grove and Niles, as well as continued meetings with other individual communities, the Northwest Water Commission, and Northwest Suburban Municipal Joint Action Water Agency (NSMJAWA) on potential transmission main and water plant improvements under various scenarios.

Water Distribution and Expansion

Improve water distribution system reliability and reduce water loss by expanding on the current water main replacement and water main leak detection programs. Goals are to supplement water main replacement with water main lining where feasible, to improve upon our historical 1% annual water main renewal rate, and to survey the entire distribution system for leaks on an annual cycle.

Complete other major distribution system improvements including rehabilitation and replacement of water mains on Sheridan Road between Isabella Street and Chicago Avenue.

Coordination for Efficient Project Funding

Coordinate capital improvement projects with the Street Resurfacing Program and with TIF District improvement projects to ensure cost-effective and efficient use of capital improvement funding.

Design and Fund Large Diameter Sewer Rehabilitation

Perform engineering design and secure state low-interest loan funding for two additional large diameter sewer rehabilitation projects scheduled for 2016 and 2017.

Continue Small Diameter Sewer Rehabilitation

Continue the annual small diameter sewer CIPP rehabilitation program at a rate of at least 1% of the combined sewer system rehabilitated per year.

Prevent Sewer Deterioration with Rehabilitation Program

Implement a larger scale sewer structure rehabilitation program to address deterioration of sewer structures on arterial streets.

Continue Coordination with Street Resurfacing Program

Continue to coordinate the inspection and repair of sewer mains and drainage structures in advance of the street resurfacing program.

Continue Preventative Measures for Sewer Mains

Continue preventative maintenance cleaning and inspection of sewer mains and drainage structures.

Combined and Storm Sewer Inspections

Continue to perform inspection of combined and storm sewer outfalls in accordance with IEPA requirements.

Increase Stormwater Management Initiatives

Increase stormwater management initiatives in compliance with requirements for National Pollution Discharge Elimination System (NPDES) permit and Municipal Separate Storm Sewer System (MS4) permit.

Water Treatment Plant Data

Intakes

36/42" – 5,946' long, 28' deep

48" – 5,300' long, 28' deep

54" – 5,340' long, 28' deep

Suction Wells

2 – 22' diameter x 74' deep with traveling screens

1 – 20' diameter x 52.5' deep

Low Lift Pumps

2 – 30 mgd, electric motor driven

3 – 15 mgd, dual drive, electric/natural gas

1 – 30 mgd, dual drive, electric/natural gas

Total capacity of 135 mgd

Emergency standby capacity of 75 mgd

Flash Mix Basin

14.75' x 14.75' x 31.58' deep

Single vertical shaft mixer

Counter-flow rotation

Application point for alum, chlorine, fluoride, polymer, and carbon

Rated capacity 108 mgd w/ partial bypass

Slow Mix/Settling Basins

Four double-deck basins with series flow

2 – 2.865 MG capacity, five 60' shafts per basin, 4 paddle wheel sections

2 – 4.3 MG capacity, eight 60' shafts per basin, 4 paddle wheel sections

Retention time at 108 mgd (flash mix capacity) is 3 hours and 11 minutes

Treated Water Elevated Storage

South – 5.0 MG, 640 Hartrey Avenue

North – 7.5 MG, 2536 Gross Point Road

Filters

Anthracite-capped rapid sand filters

12 – 3.19 mgd, 738 ft² each, surface loading rate of 3 gpm/ft²

12 – 8.01 mgd, 1,391 ft² each, surface loading rate of 5 gpm/ft²

Total rated capacity of 134 mgd

Automatic surface and backwash system on all 24 filters

Treated Water Ground Storage

8 clearwells beneath filters – 4.4 MG total

1 clearwell beneath NU parking lot – 5.0 MG

Total Plant Storage – 9.4 MG

High Lift Pumps

1 – 15 mgd, electric motor driven

2 – 25 mgd, electric motor driven

1 – 10 mgd, dual drive, electric/natural gas

2 – 15 mgd, dual drive, electric/natural gas

1 – 22 mgd, dual drive, electric/natural gas

1 – 20 mgd, natural gas engine

Total capacity of 147 mgd

Emergency standby capacity of 82 mgd

Wash Water Pumps

2 – 20 mgd

2 – 10 mgd

Detention Tank


80' x 192' x 12' deep, divided in 2 sections

Total capacity of 1.1 MG

1 – submersible sludge pump at 700 gpm

Legend: MG = million gallons; mgd = million gallons per day; gpm = gallons per minute

Water Treatment Schematic

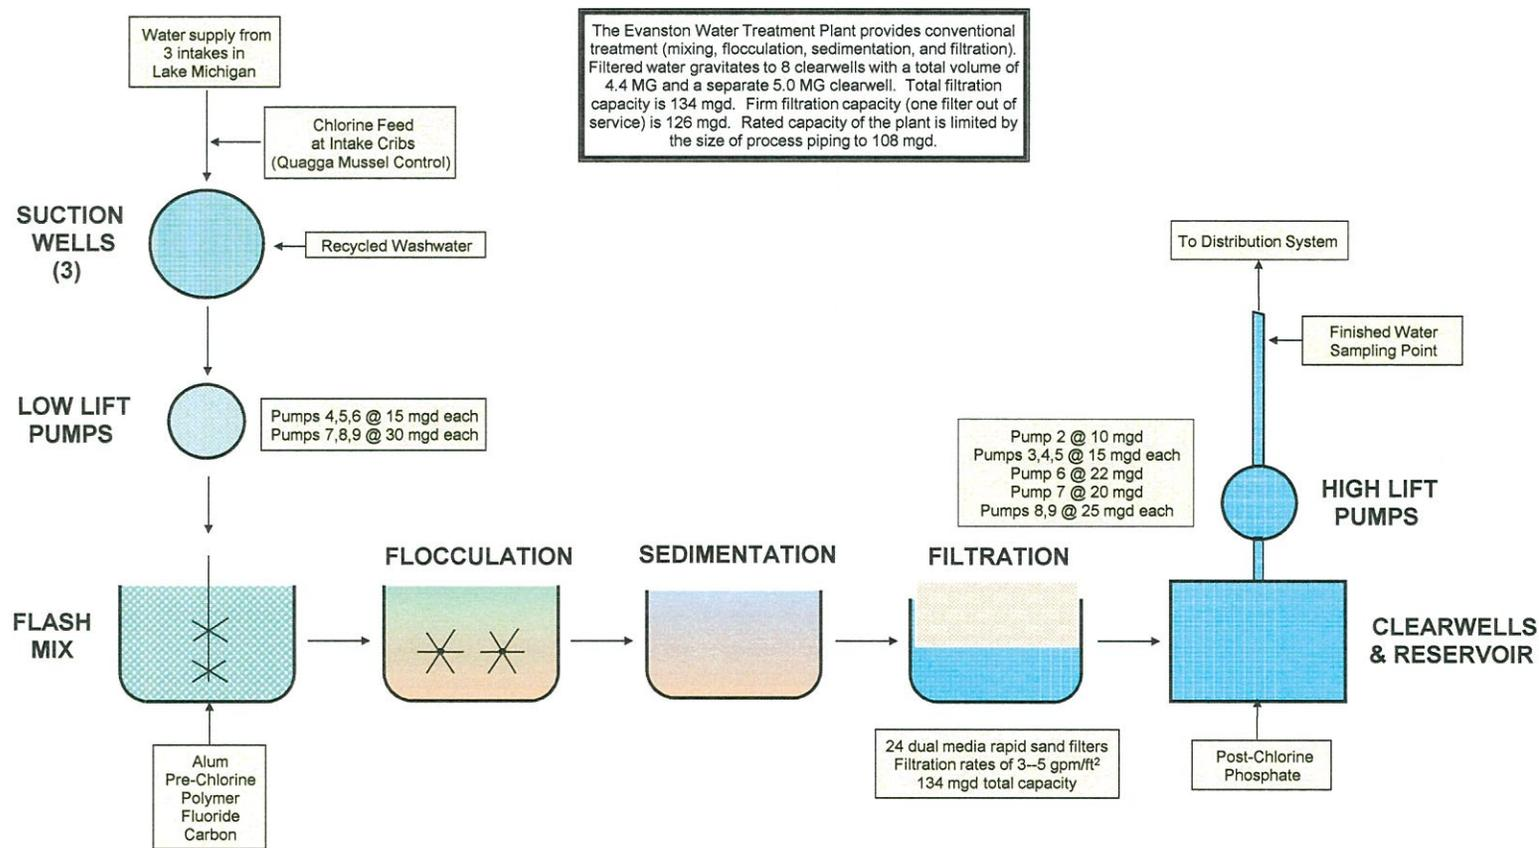

Volume (MG)	0.109	2.384	13.516	1.730	9.560*
-------------	-------	-------	--------	-------	--------

Notes:
*based on 8.0' depth

Water Works Improvements (1874 to 2015)

- 1874** Evanston Community Water System established
- 1913** Constructed 12 mgd filter plant
- 1923** Expanded filter plant to 24 mgd
- 1934** Constructed 5.0 million gallon underground reservoir at plant site
- 1944** Contracted to supply water to Skokie
- 1949** Constructed high lift (finished water) pumping station
Expanded filter plant to 48 mgd
Constructed slow mix basins 1 and 2
- 1956** Constructed 48" intake and low lift (raw water) pump station
Constructed 36" feeder main to Skokie
- 1964** Expanded filter plant to 72 mgd
Constructed additional 36" feeder main to Skokie
Constructed slow mix basins 3 and 4
- 1971** Installed 20 mgd high lift pump and natural gas engine
- 1974** Constructed filter wash water detention basin, 1.1 MG capacity
- 1976** Constructed 54" intake, 5,340 feet in length
Extended 48" intake to 5,300 feet in length
- 1981** Constructed material storage building at south water tank yard
Installed 3 new boilers (2 – 50 HP and 1 – 20 HP)
Replaced 5 kV switchgear and motor starter equipment for low lift pumps
Upgraded slow mix equipment in basins 1 and 2
- 1982** Installed two 30 mgd low lift pumps
Replaced 5 kV motor starter center for high lift pumps
- 1983** Constructed new chemical building and chemical feed system
Installed a 500 kW emergency generator
Rehabilitated six 1914 and six 1924 filters to increase rate to 3 MGD per filter
- 1984** Constructed 5 MG standpipe with booster station to replace the 1.5 MG elevated tank in southwest Evanston

- 1985** Began selling water to Northwest Water Commission at the rate of 10 MGD
Installed dual drive 22 MGD high lift pump and new piping
Installed two 48" diameter pipes from reservoir to east side of high lift suction tunnel
Completed system automation which provided a microprocessor-based digital control system to perform control and supervisory functions
- 1986** Constructed a 7.5 MG standpipe with booster station to replace the 1.0 MG elevated tank in northwest Evanston
Began pumping to Northwest Water Commission reservoir in Des Plaines
- 1988** Installed two 700 gpm sludge pumps with automatic samplers in the settling basins along with 3,400 feet of 8" diameter sludge main from the Filtration Plant to the MWRD interceptor at Lincoln Street and Asbury Ave
- 1989** Completed filter control upgrade to microprocessors
- 1990** Turndown and extension of 48" raw water intake lines into North and South suction wells
Upgraded west filter influent valves from 16" to 24"
- 1991** Upgraded electrical substation and switchgear to 3,750 kVA
Upgraded west filter effluent piping
- 1992** Installed chlorine feed system to intakes for zebra/quagga mussel control
Installed a 15 MGD high lift pump to replace one 8 MGD pump and one 6 MGD pump
Installed two 48" diameter butterfly valves on suction piping from reservoir to high lift suction wells
Installed hydrofluosilicic acid tank and feed system in garage #6
Installed 60" diameter flash mix bypass pipe to influent duct of settling basins
Replaced slow mix equipment and flushing system in basins 3 and 4
Replaced 480 V filter plant switchgear
Installed blended phosphate system and initiated blended phosphate treatment for corrosion control
- 1994** Constructed new chemical storage and handling building
- 1995** Replaced Low Lift Pump #6 gasoline engine with natural gas engine
- 1996** Replaced 1949 filter building roof
Constructed loading dock on 1913 filter building
- 1997** Replaced High Lift Pump #2 gasoline with a natural gas engine
- 1998** Replaced Low Lift Pump #5 and #7 dual drive gasoline engines with natural gas fueled engines


- 2000** Installed individual effluent turbidimeters on all 24 filters
- 2001** Converted High Lift Pump #3 to dual drive
Replaced filter bottoms and rehabbed six filters in 1948 filter addition
- 2002** Completed installation of automatic fixed radio meter reading system
Replaced effluent settling basin sluice gates with rectangular butterfly valves
- 2003** Installed uninterruptible power supply to filtration and pumping equipment
- 2004** Constructed garages east of the settling basins
Constructed an access way to the chemical building from filtration division
Installed a scrubber
- 2005** Replaced Low Lift Pump #4 gasoline engine with natural gas engine
- 2006** Replaced Low Lift Pump #7
- 2008** Renovated administrative offices
Expanded filter shop area
- 2009** Implemented AQUAS (Harris) Utility Billing System
Installed anchor ice and zebra mussel control systems in 54" intake
- 2010** Installed a 25 kW solar energy facility on the high lift pump station roof
- 2012** Rehabilitated Filters 19-24 with new media, underdrains, and backwash equipment
Rehabilitated the 1963 filter building structure and roof
Replaced all windows in the high lift pump station
Replaced electrical switchgear in high lift pump station
- 2013** Modified electrical distribution equipment and settings on protective devices throughout the water treatment plant to reduce arc flash hazards
Conducted comprehensive maintenance and evaluation of electrical Switchgears
- 2014** Replaced five roofs: Boiler Room, Low Lift Pumping Station, Chemical Building, and 1948 Filter Building (2 roofs)
Replaced master flow meter on the 48" diameter feeder main to Evanston and Skokie
- 2015** Improvements to one of the water plant intakes, upgrade/replacement of the City's automatic meter reading and billing system, replacement of the master flow meter on the primary transmission main leaving the water plant, and chlorination equipment replacement.

Notes: MG = million gallons
mgd = million gallons per day
HP = horsepower
kV = kilovolt
kW = kilowatt
kVA = kilovolt-ampere

Service Area & Population


	Area (Square Miles)	2015 Persons*
Evanston	7.8	75,658
Skokie	10	65,112
NORTHWEST WATER COMMISSION		
Arlington Heights	16.6	76,024
Buffalo Grove	9.5	41,701
Palatine	13.6	69,387
Wheeling	8.7	38,010
Total Served	66.2	365,892

* U.S. Census Bureau, 2014 Estimate

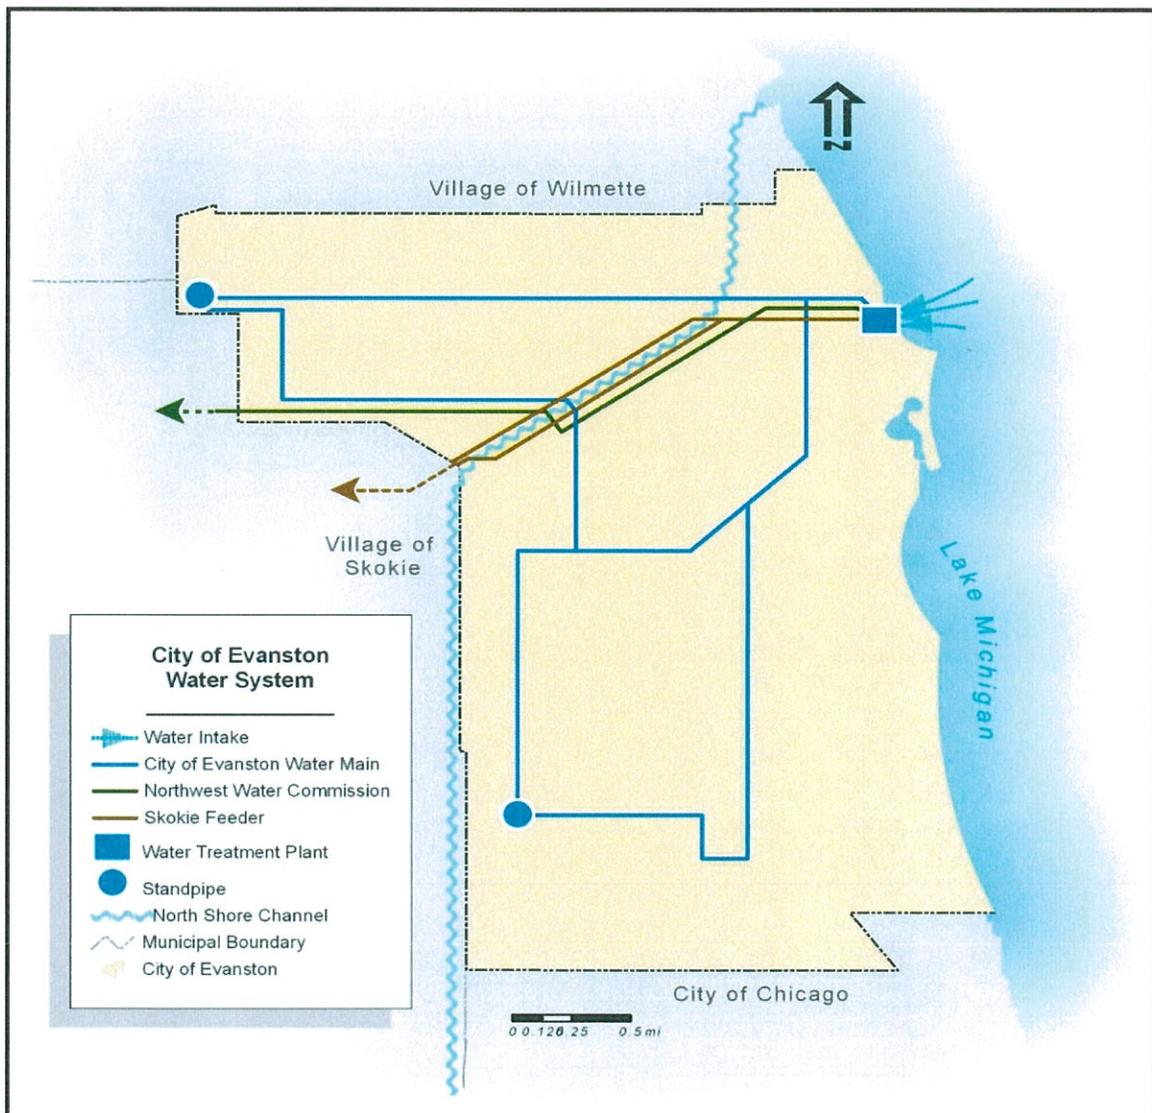


Pumpage to Distribution

2015 Pumpage to Distribution (MG)

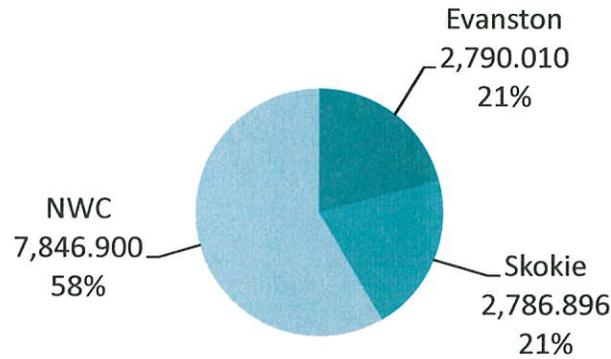

2015 Total Pumpage: 13,423,806,000 gallons


2014 Pumpage to Distribution (MG)

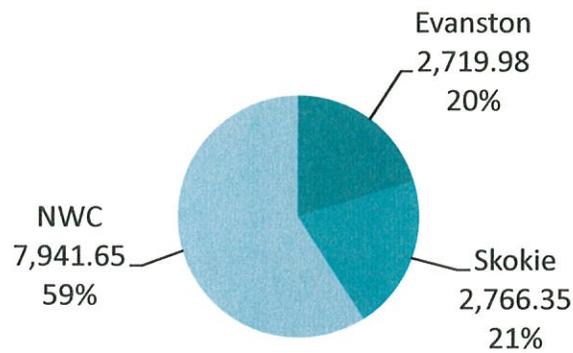

2014 Total Pumpage: 13,427,979,000 gallons

Water Revenues*

	2014	2015
Evanston Water Sales	\$6,357,400	\$6,651,000
Skokie Water Sales	\$2,913,000	\$2,800,000
NWC Water Sales	\$5,200,000	\$5,130,000
Debt Proceeds	\$4,300,000	\$3,525,000
Miscellaneous Revenue**	\$637,797	\$527,375
Total Water Revenue	\$19,410,211	\$18,635,390

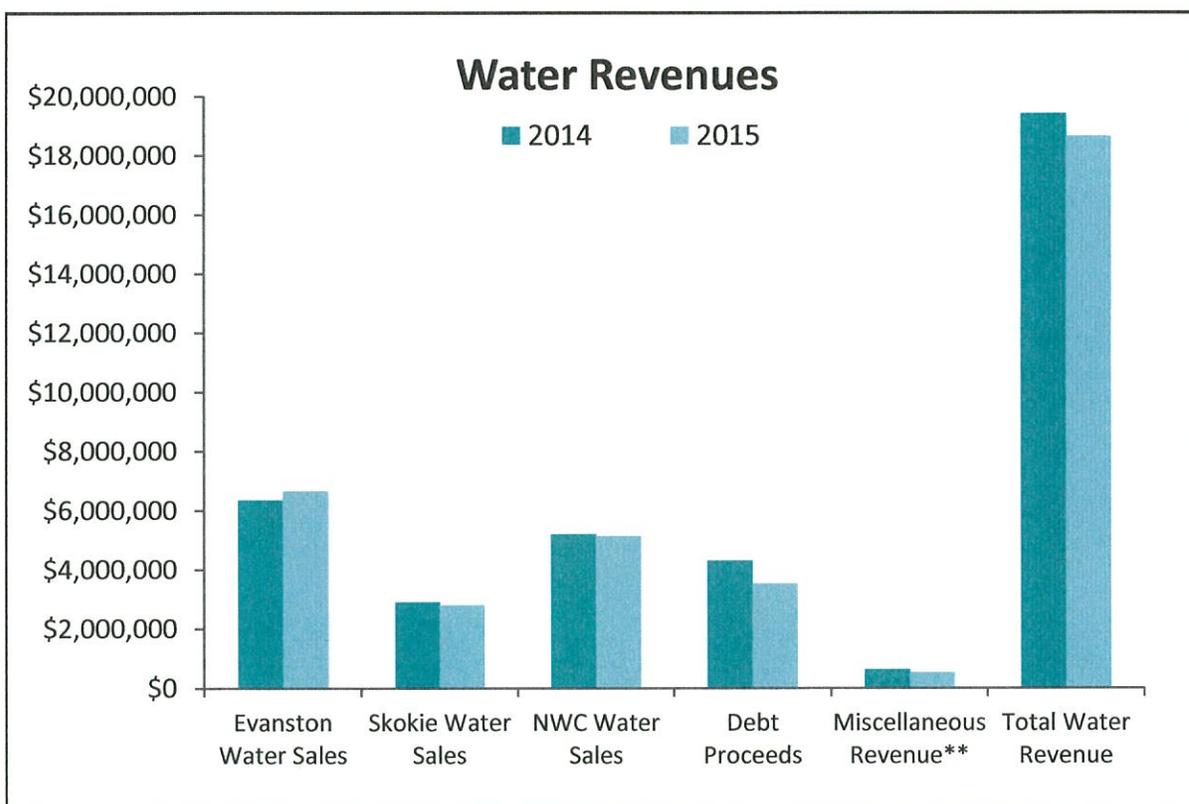


* Financial data are based on actual expenses and do not include audit adjustments such as depreciation and inventory. For audited financial records, see the Comprehensive Annual Financial Report for the City of Evanston, <http://www.cityofevanston.org/transparency/budget-financial-reports/>.

** Miscellaneous Revenue includes cross connection control fees, investment earnings, property sales and rentals, fees, outside work, grants, development fees, phosphate sales, and merchandise sales.

Water Operating & Maintenance Expenses*

	2014	2015
General Support	\$898,468	\$1,117,602
Pumping	\$2,172,119	\$2,392,399
Filtration	\$2,572,444	\$2,293,890
Distribution	\$1,450,368	\$1,629,360
Meter Maintenance	\$272,565	\$202,759
Other Operating Expenses**	\$4,670,151	\$4,382,080
Total	\$12,036,115	\$12,018,091

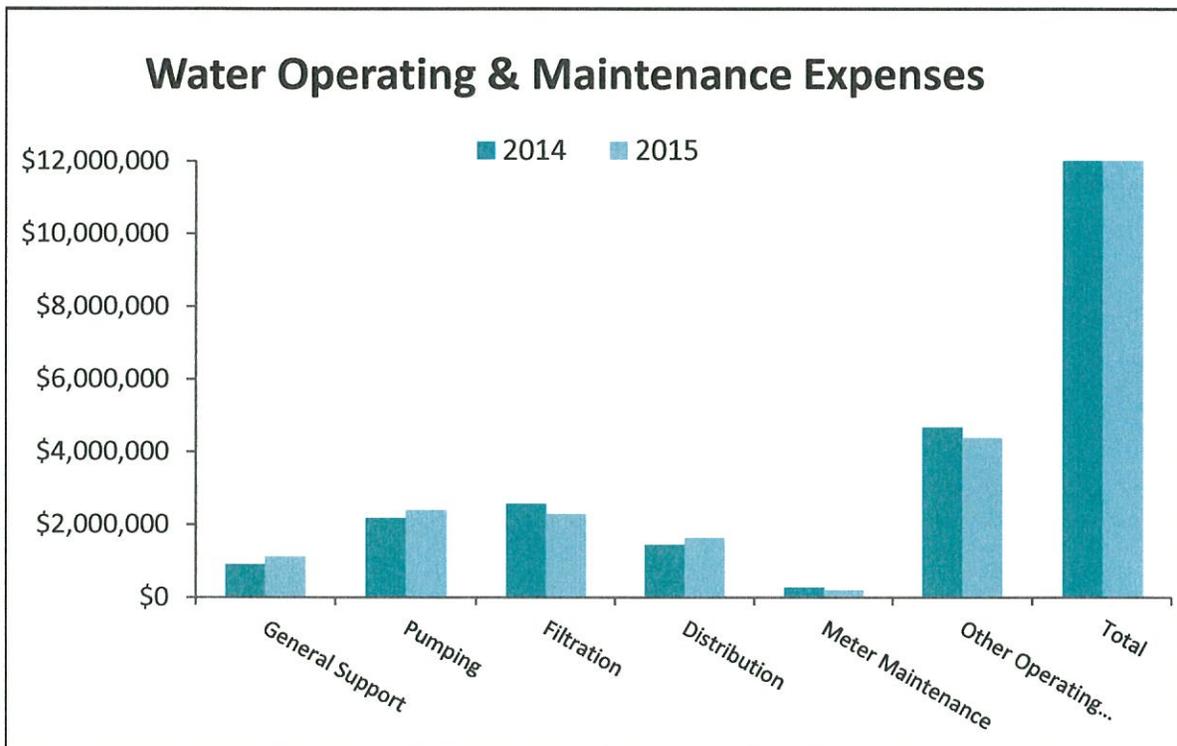

* Financial data are based on actual expenses and do not include audit adjustments such as depreciation and inventory. For audited financial records, see the Comprehensive Annual Financial Report for the City of Evanston, <http://www.cityofevanston.org/transparency/budget-financial-reports/>.

**Other Operating Expenses include capital outlay, interfund transfers (general and insurance), and other operating expenses.

Employee Profile and Safety

Section	Employee Full-Time Equivalents
Administration	5.0
Pumping	12.0
Filtration	14.0
Distribution	12.0
Sewer	11.3
Meter	1.5
Total	55.8

Section	Number of AFMD* Beginning of Year	Number of Accidents	Highest consecutive AFMD achieved	Date Highest AFMD Achieved	Number of AFMD End of Year
Pumping	257.0	0	2,620.5	10/31/2015	2,620.5
Filtration	2,584.5	0	5,320.5	10/31/2015	5,320.5
Distribution & Sewer	1,100.5	2	3,553.0	10/26/2015	57.5

* AFMD = Accident Free Man Days

Pumping


Evanston's Pumping Division manages the City's three Lake Michigan water supply intakes, pumping of raw water to the start of the water treatment process; pumping of treated water to retail customers in Evanston as well as wholesale customers; and operation and maintenance of Evanston's treated water storage facilities and remote water pumping stations. This division also monitors water storage tanks in the Village of Skokie, as well as controlling the rate of water supply to the Northwest Water Commission.



High Lift Pumping Station at the Evanston Water Treatment Plant

There is at least one pump operating at the Evanston Water Treatment Plant at all times, to ensure that a sufficient quantity of water is always available for public consumption and firefighting. There is always at least one water operator present at the Pumping Station to control water supply and pressure and respond to emergencies.

Evanston has been pumping drinking water from the site of the existing water treatment plant on Lincoln Street since 1874. The original "water works" consisted of a coal-fired steam engine and a single pump with a capacity of 2 million gallons per day. Construction of a pumping station to serve the entire City drastically improved Evanston's ability to fight fires and allowed the City to reliably deliver Lake Michigan water to homes and businesses on demand for the first time.

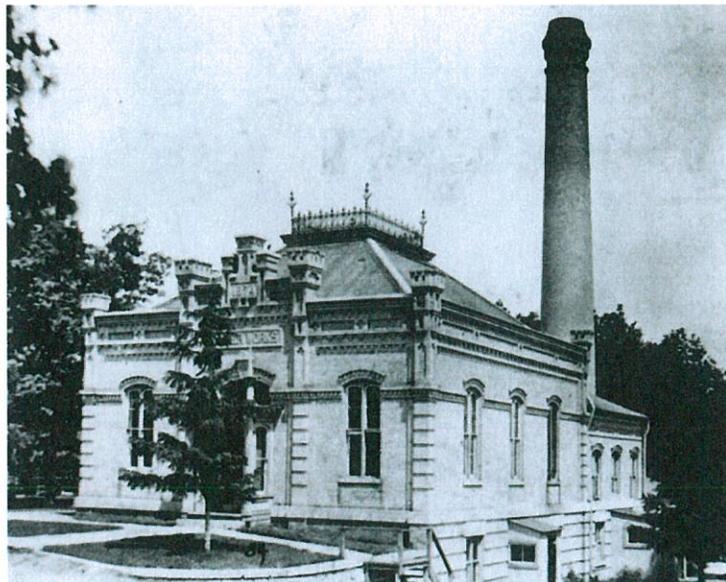

Evanston's original pumping station in 1874

2015 Monthly Pumpage (MG)

Month	Lake	Wash	Net	Finished	Pumpage To		
	Water Pumpage	Water Recycled	Raw Water Pumpage	Water Pumpage	Evanston	Skokie	N.W.C.
Jan-15	1,105.958	15.243	1,121.201	1,091.684	219.493	224.994	647.197
Feb-15	993.608	14.742	1,008.350	979.494	197.429	203.955	578.110
Mar-15	1,051.862	14.352	1,066.214	1,037.606	214.803	221.063	601.740
Apr-15	1,038.910	13.795	1,052.705	1,094.833	254.304	208.254	632.275
May-15	1,170.487	21.359	1,191.846	1,131.353	216.660	233.280	681.413
Jun-15	1,134.827	15.467	1,150.294	1,122.625	220.010	235.514	667.101
Jul-15	1,241.264	19.130	1,260.394	1,231.148	244.142	255.542	731.464
Aug-15	1,345.617	27.227	1,372.844	1,326.781	244.260	286.287	796.234
Sep-15	1,201.943	21.155	1,223.098	1,187.660	235.267	244.463	707.930
Oct-15	1,122.857	15.050	1,137.907	1,113.129	224.286	239.720	649.123
Nov-15	1,026.820	16.823	1,043.643	1,013.638	275.273	204.665	533.700
Dec-15	1,037.670	5.942	1,043.612	1,093.855	244.083	229.159	620.613
Total	13,471.823	200.285	13,672.108	13,423.806	2,790.010	2,786.896	7,846.900


2015 Average Day Pumpage (MGD)

Month	Lake	Wash	Net	Finished	Pumpage To		
	Water Pumpage*	Water Recycled	Raw Water Pumpage	Water Pumpage	Evanston	Skokie	N.W.C.
Jan-15	35.676	0.492	36.168	35.216	7.080	7.258	20.877
Feb-15	35.486	0.527	36.013	34.982	7.051	7.284	20.647
Mar-15	34.400	0.463	34.394	33.471	6.929	7.131	19.411
Apr-15	33.939	0.460	35.090	36.494	8.477	6.942	21.076
May-15	37.758	0.445	33.958	36.495	6.989	7.525	21.981
Jun-15	37.828	0.516	38.343	37.421	7.334	7.850	22.237
Jul-15	40.041	0.617	40.658	39.714	7.876	8.243	23.596
Aug-15	43.407	0.878	44.285	42.799	7.879	9.235	25.685
Sep-15	40.065	0.705	40.770	39.589	7.842	8.149	23.598
Oct-15	36.221	0.485	36.707	35.907	7.235	7.733	20.939
Nov-15	34.227	0.561	34.788	33.788	9.176	6.822	17.790
Dec-15	33.473	0.192	33.665	35.286	7.874	7.392	20.020
Average	36.909	0.549	37.458	36.778	7.644	7.635	21.498

Note: "Pumpage to Evanston" includes process and domestic water uses at the water treatment plant.

Annual Pumpage (MG)

Year	Lake Water Pumpage	Wash Water Recycled	Total Raw Water Pumpage	Finished Water Pumpage	Pumpage To		
					Evanston	Skokie	N.W.C.
2015	13,471.823	200.285	13,672.108	13,423.806	2,790.010	2,786.896	7,846.900
2014	13,416.872	239.547	13,656.419	13,427.979	2,719.978	2,766.348	7,941.653
2013	13,925.102	247.609	14,172.711	13,814.461	2,930.278	2,787.256	8,096.927
2012	14,817.637	322.302	15,110.465	14,627.115	2,939.417	3,068.004	8,619.694
2011	13,939.618	212.426	14,152.042	13,941.167	2,991.848	2,866.652	8,082.667
2010	14,087.849	218.251	14,306.100	14,268.257	2,701.569	3,094.554	8,472.134
2009	14,363.047	193.841	14,556.888	14,350.335	3,140.898	2,829.824	8,379.613
2008	14,872.552	134.595	15,007.147	14,693.877	3,142.816	2,961.341	8,589.720
2007	15,905.381	192.088	16,097.469	15,771.451	3,207.422	3,564.781	8,999.248
2006	15,332.651	160.528	15,493.179	15,174.631	2,950.699	3,329.305	8,894.627

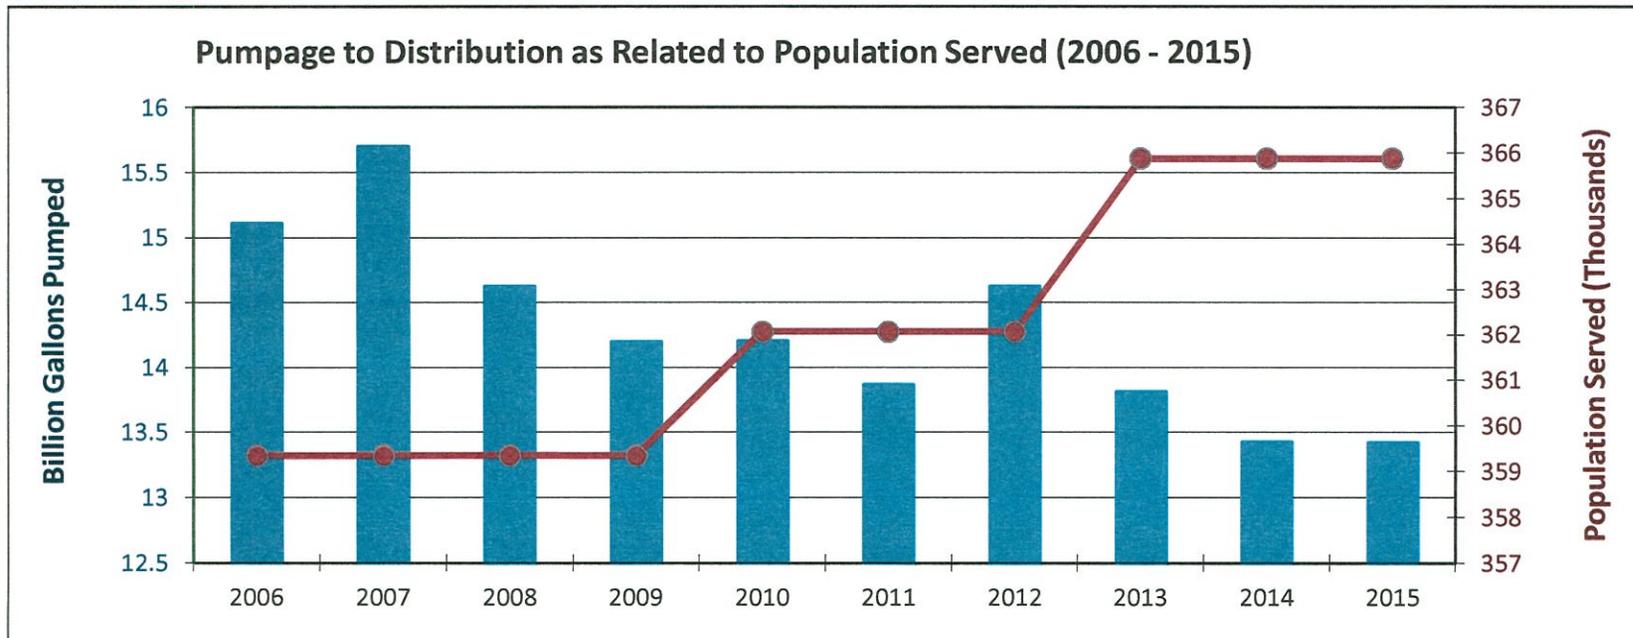

Average Daily per Capita Consumption




Year	Evanston		Skokie		NWC		Total	
	Population	Per Capita Use (gpcd)						
2015	75,570	101	65,176	117	225,137	95	365,883	101
2014	75,570	99	65,176	116	225,137	97	365,883	101
2013	75,570	106	65,176	117	225,137	99	365,883	103
2012	74,486	105	64,784	130	222,802	106	362,072	110
2011	74,486	107	64,784	121	222,802	99	362,072	105
2010	74,486	97	64,784	131	222,802	104	362,072	107
2009	74,360	110	63,333	122	221,364	104	359,057	108
2008	74,360	114	63,333	128	221,364	106	359,057	112
2007	74,360	116	63,333	154	221,364	111	359,057	120
2006	74,360	107	63,633	143	221,364	110	359,357	115

Maximum Pumpage to Distribution

Year	Max Day Pumpage Volume (MG)	Peak Hour Pumpage Rate (MGD)	Peak Hour Pumpage Volume (MG)
2015	53.300	54.816	2.284
2014	48.907	55.848	2.327
2013	56.946	72.072	3.003
2012	69.210	85.680	3.570
2011	66.096	75.144	3.131
2010	57.02	89.520	3.730
2009	58.940	67.440	2.810
2008	57.478	69.480	2.895
2007	65.997	70.632	2.943
2006	65.961	70.248	2.927

Historical Maximum Day Pumpage: 95.154 MG on July 7, 1989

Maximum Day and Peak Hour Pumpage

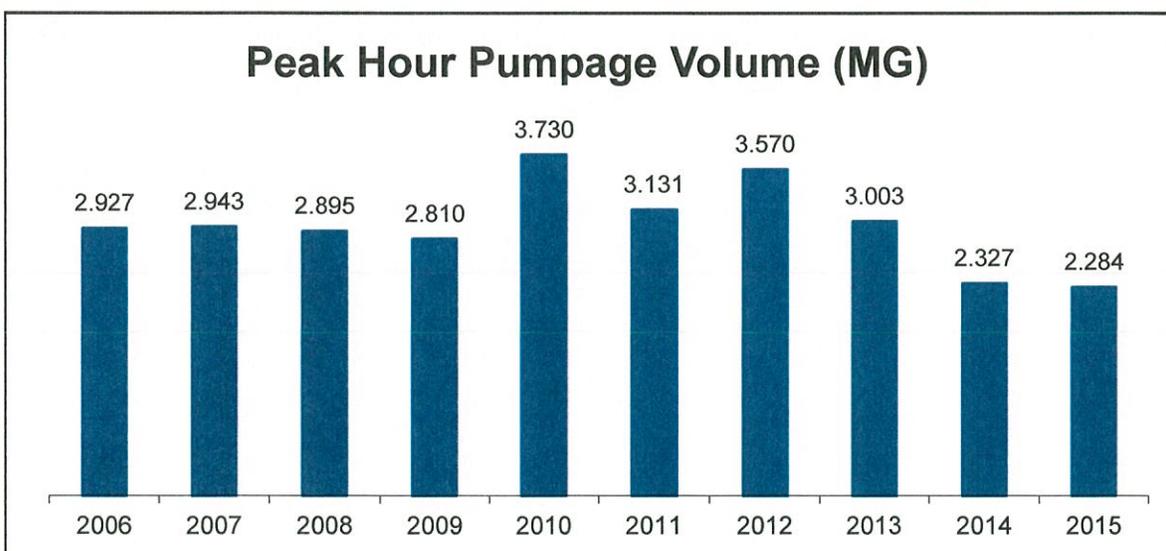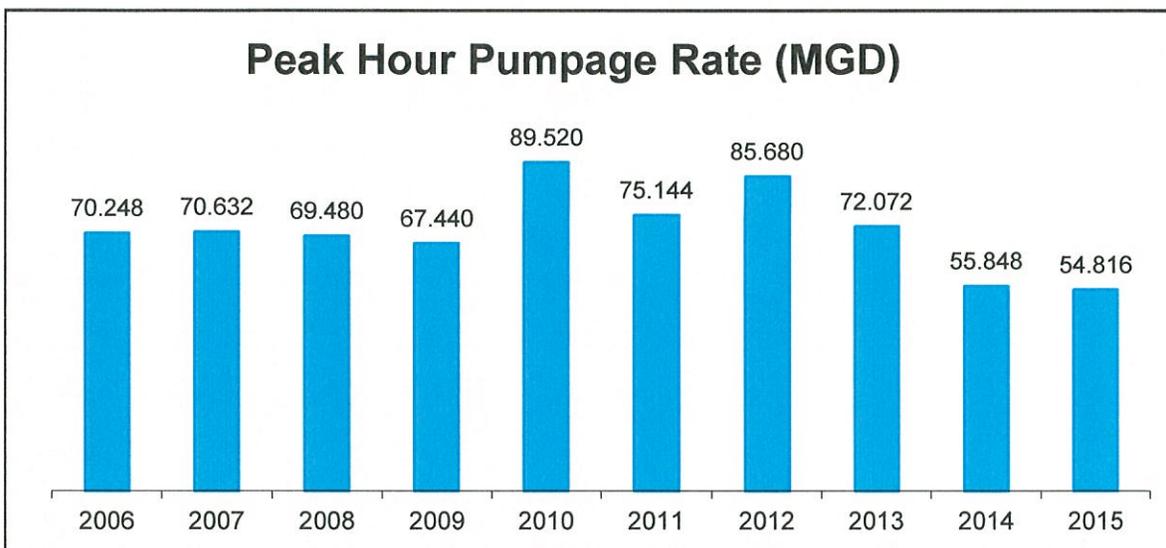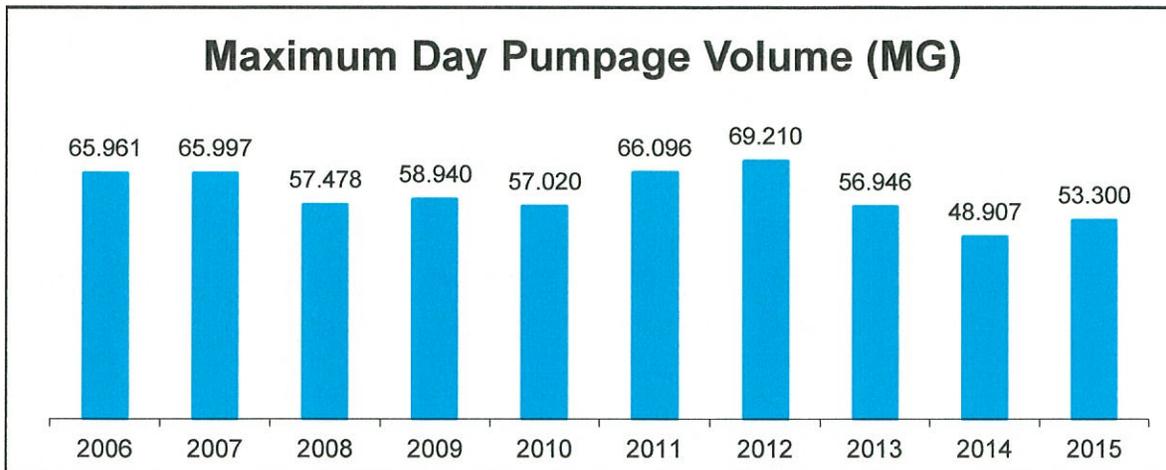

Maximum Pumpage Days (MGD)

Year	Maximum Day Pumpage To			
	Distribution	Evanston	Skokie	NWC
2015	August 14th 53.300	August 6th 11.852	August 14th 10.95	August 2nd 30.414
2014	August 4th 48.907	August 15th 9.875	August 4th 10.87	August 4th 30.871
2013	August 28th 56.946	August 28th 12.585	August 28th 11.209	August 27th 33.374
2012	July 17th 69.210	July 17th 18.580	July 17th 13.579	July 6th 43.775
2011	July 18th 66.096	July 18th 12.614	July 18th 13.724	July 19th 40.820
2010	July 17th 57.020	July 29th 13.643	August 20th 12.957	July 19th 34.661
2009	August 14th 58.940	August 13th 13.992	August 14th 11.495	August 6th 34.725
2008	July 30th 57.478	July 30th 11.788	July 30th 11.495	July 29th 33.670
2007	August 2nd 65.997	August 2nd 17.774	June 11th 16.493	August 2nd 35.946
2006	August 1st 65.961	July 29th 14.127	August 1st 15.236	August 1st 37.221

Historical Maximum Day Pumpage to Distribution: 95.154 MG on July 7, 1989

	Total Energy Cost	Elec Energy Cost	Cost per MG pumped
1970	\$69,206	\$69,206	\$7.59
1971	\$75,843	\$75,843	\$8.28
1972	\$76,641	\$66,229	\$8.73
1973	\$78,520	\$58,540	\$8.74
1974	\$92,104	\$72,047	\$10.67
1975	\$113,234	\$88,231	\$13.47
1976	\$145,279	\$96,996	\$15.98
1977	\$155,737	\$145,937	\$16.79
1978	\$173,761	\$169,149	\$19.55
1979	\$217,747	\$212,834	\$23.15
1980	\$250,115	\$246,166	\$28.95
1981	\$274,300	\$267,937	\$32.33
1982	\$318,153	\$311,427	\$37.25
1983	\$387,143	\$377,141	\$42.71
1984	\$428,628	\$416,066	\$45.74
1985	\$547,580	\$533,425	\$44.58
1986	\$705,418	\$674,133	\$47.15
1987	\$791,329	\$765,866	\$46.44
1988	\$780,265	\$741,530	\$41.74
1989	\$779,051	\$753,646	\$44.86
1990	\$687,866	\$672,118	\$41.88
1991	\$845,345	\$830,040	\$47.28
1992	\$769,750	\$749,167	\$45.42
1993	\$707,587	\$682,901	\$43.46
1994	\$693,148	\$675,172	\$39.49
1995	\$836,582	\$810,716	\$49.13
1996	\$845,711	\$826,401	\$50.83
1997	\$884,520	\$828,788	\$54.10
1998	\$861,941	\$845,527	\$50.74
1999	\$881,844	\$870,486	\$50.39
2000	\$864,294	\$840,792	\$51.83
2001	\$797,808	\$777,474	\$49.09
2002	\$891,470	\$872,247	\$53.43

2003	\$853,408	\$833,640	\$52.55
2004	\$823,081	\$794,401	\$52.93
2005	\$888,931	\$851,054	\$53.44
2006	\$830,688	\$797,307	\$54.74
2007	\$1,006,072	\$955,552	\$63.79
2008	\$1,022,156	\$934,832	\$69.56
2009	\$857,455	\$829,181	\$60.38
2010	\$899,264	\$821,166	\$63.03
2011	\$957,517	\$841,245	\$68.68
2012	\$1,008,323	\$924,422	\$68.94
2013	\$866,152	\$779,226	\$62.70
2014	\$873,477	\$787,444	\$65.05
2015	\$873,856	\$810,030	\$65.10

Filtration

The Filtration Division manages the water treatment process, including chemical addition, sedimentation, filtration, and disinfection. This involves operation and maintenance of 5 chemical feed systems, 4 settling basins, 24 filters, and numerous pipes, valves, and instrumentation systems. There is always at least one state-certified water treatment operator at the filtration plant at all times, who monitors instrumentation and water quality testing results to ensure that the water is always safe to drink.



Filters 1 – 12 in operation at the Evanston Water Treatment Plant

This division also includes the City's Water Quality Laboratory, which monitors Evanston's drinking water for compliance with state and federal water quality regulations and completes regular reporting to the public and the Illinois Environmental Protection Agency to certify the quality of Evanston's water.


Full-scale water treatment began in Evanston in 1914. The process included settling basins with chemical addition to allow larger contaminants to drop out of the water by gravity, filtration to remove smaller contaminants, and disinfection with chlorine. The new treatment process virtually eliminated waterborne disease in Evanston. This process was state-of-the-art at the time, and Evanston was one of the first communities in the region to adopt full-scale water treatment with rapid sand filtration. Though only the filters from the 1914 treatment plant survive to this day, Evanston's water treatment process still follows the same steps.



Filters 1 – 12, photo taken in 1924

	Alum	Polymer	Phosphate	Chlorine	Fluoride	Total Cost	Carbon	Total Cost With Carbon
1986	38227.50	7957.04		37684.32	22226.00	\$106,095	20145.94	\$126,241
1987	43234.14	10737.67		46763.69	32992.32	\$133,728	31853.55	\$165,581
1988	39351.16	8885.04		52119.45	33053.58	\$133,409	22141.03	\$155,550
1989	38595.68	8088.40		48288.23	53395.10	\$148,367	23320.70	\$171,688
1990	52864.79	12197.66		42218.86	42536.24	\$149,818	14450.31	\$164,268
1991	64361.52	14742.20		34277.48	43056.18	\$156,437	20561.04	\$176,998
1992	54091.93	20232.76	29356.79	31577.38	38853.68	\$174,113	16828.45	\$190,941
1993	53058.67	23626.74	79495.94	17427.46	39723.57	\$213,332	3181.18	\$216,514
1994	54313.63	28351.53	64759.35	36375.63	44674.6	\$228,475	17587.7	\$246,062
1995	53762.16	26540.19	64818.55	36538.8	42733.13	\$224,393	14583.8	\$238,977
1996	53878.87	23639.83	172336.54	34403.8	41370.45	\$325,629	35108.64	\$360,738
1997	54460.47	24053.52	189299.58	37555.31	47106.72	\$352,476	147968.64	\$500,444
1998	\$54	\$24	\$169	\$41	\$48	\$335	\$158	\$493
1999	\$47	\$17	\$170	\$29	\$46	\$308	\$76	\$384
2000	\$52	\$14	\$165	\$33	\$50	\$313	\$0	\$313
2001	\$47	\$14	\$130	\$25	\$48	\$264	\$0	\$264
2002	\$62	\$14	\$146	\$36	\$49	\$308	\$0	\$308
2003	\$54	\$17	\$140	\$34	\$49	\$294	\$0	\$294
2004	\$0	\$0	\$124	\$35	\$40	\$199	\$0	\$199
2005	\$52	\$15	\$148	\$34	\$48	\$298	\$0	\$298
2006	\$56,986	\$15,652	\$49,339	\$41,984	\$67,801	\$231,762	\$0	\$231,762
2007	\$77,884	\$14,915	\$51,095	\$40,201	\$96,939	\$281,034	\$0	\$281,034
2008	\$109,186	\$15,449	\$63,691	\$38,423	\$148,098	\$374,847	\$0	\$374,847
2009	\$124,161	\$17,424	\$105,650	\$31,767	\$180,628	\$459,630	\$0	\$459,630
2010	\$166,179	\$17,616	\$74,321	\$32,363	\$196,597	\$487,076	\$0	\$487,076
2011	\$181,138	\$18,725	\$85,512	\$33,235	\$185,938	\$504,548	\$0	\$504,548
2012	\$185,761	\$22,323	\$81,072	\$39,758	\$163,009	\$491,923	\$0	\$491,923
2013	\$172,390	\$17,702	\$74,978	\$32,155	\$144,061	\$441,286	\$0	\$441,286
2014	\$146,237	\$13,996	\$76,722	\$29,470	\$150,522	\$416,947	\$0	\$416,947
2015	\$153,484	\$12,883	\$75,103	\$29,445	\$132,738	\$403,653	\$0	\$403,653

Annual Chemical Cost

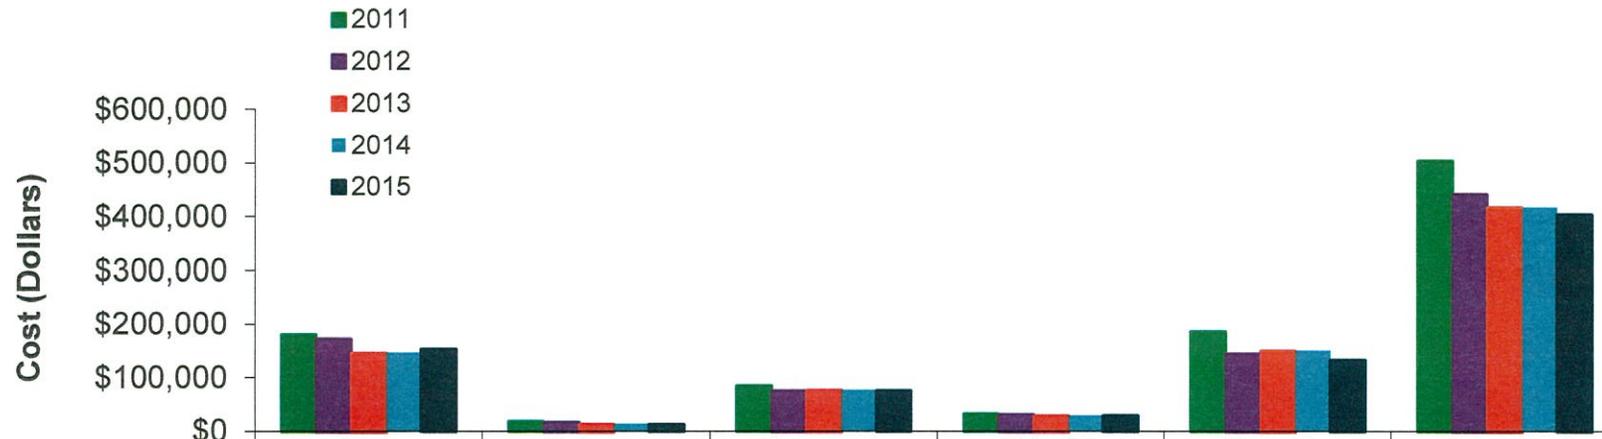

	Alum	Polymer	Phosphate	Chlorine	Fluoride	Total Cost
■ 2011	\$181,138	\$18,725	\$85,512	\$33,235	\$185,938	\$504,548
■ 2012	\$172,390	\$17,702	\$74,978	\$32,155	\$144,061	\$441,286
■ 2013	\$146,237	\$13,996	\$76,722	\$29,470	\$150,522	\$416,947
■ 2014	\$146,237	\$13,996	\$76,722	\$29,470	\$150,522	\$416,947
■ 2015	\$153,484	\$12,883	\$75,103	\$29,445	\$132,738	\$403,653

Filter Operations

Filter Runs

Year	Avg Hours per Filter Run		Total Hours per Year	
	3 MGD	8 MGD	3 MGD	8 MGD
2015	238.6	229.0	80,514	103,404
2014	226.2	201.8	95,298	104,573
2013	224.5	200.6	95,958	101,536
2012	208.7	171.5	96,000	92,402
2011	229.1	197.3	96,336	88,162
2010	229.2	198.8	96,286	100,046
2009	253.8	239.2	97,313	94,790
2008	266.7	228.5	97,050	100,601
2007	234.9	200.7	91,395	104,530
2006	245.4	226.9	105,043	105,059

Filter Washes

Year	Total Washes per Year		Max # of Washes per Day	
	3 MGD	8 MGD	3 MGD	8 MGD
2015	347	462	5	5
2014	429	557	5	7
2013	427	524	7	7
2012	476	611	7	9
2011	430	486	5	6
2010	452	559	7	7
2009	387	409	6	5
2008	369	460	6	6
2007	425	569	6	7
2006	453	503	5	6

Wash Water

Year	Total (MG)	Avg Daily %	Max Daily %
2015	200.285	1.49	5.31
2014	243.089	1.78	6.20
2013	248.996	2.13	9.72
2012	321.030	1.49	5.14
2011	211.546	1.53	15.2
2010	223.704	1.02	4.54
2009	149.063	0.95	4.15
2008	145.593	1.15	4.86
2007	192.135	1.01	3.25
2006	160.264	1.03	3.45

Bacteriological Water Analysis (Membrane Filter Method)

Report of Evanston Water Quality Control Laboratory

The U.S. Environmental Protection Agency (EPA) standard is based on the presence or absence of total coliform bacteria in a water sample. Evanston is required to collect 80 water samples per month from the distribution system. The EPA requires that no more than 5% of these monthly samples test positive for the presence of total coliform.

Distribution System		Positive for	Positive for
Year	Number Sampled	Total Coliform	Fecal Coliform
2015	989	3	0*
2014	987	4	1
2013	981	1	0
2012	995	2	0
2011	993	4	0

**In March 2015 Fecal Coliform was no longer tested due to regulation changes*

Additional Bacteriological Samples Analyzed for the Village of Skokie

Year	Number Sampled
2015	887
2014	892
2013	899
2012	914
2011	900

Raw Water	Year	Number Sampled	Colony Count	
			Average	Maximum
	2015	730 (Twice Daily)	59	>200
	2014	728 (Twice Daily)	38	>200
	2013	730 (Twice Daily)	45	>200
	2012	732 (Twice Daily)	41	>200
	2011	730 (Twice Daily)	102	>200

After Primary Treatment	Year	Number Sampled	Colony Count	
			Average	Maximum
	2015	730 (Twice Daily)	0	0
	2014	729 (Twice Daily)	0	0
	2013	730 (Twice Daily)	0	0
	2012	732 (Twice Daily)	0	0
	2011	730 (Twice Daily)	0	0

Plant Tap A.M. and P.M. Samples	Year	Number Sampled	Colony Count	
			Average	Maximum
	2015	1460 (4 times Daily)	0	0
	2014	1459 (4 times Daily)	0	0
	2013	1460 (4 times Daily)	0	0
	2012	1464 (4 times Daily)	0	0
	2011	1460 (4 times Daily)	0	0

Taste & Odor, Turbidity, Temperature and Fluoride Report of Evanston Water Quality Control Laboratory

Taste & Odor

Year	Number of Tests
2015	506
2014	498
2013	508
2012	504
2011	756

Turbidity (Expressed in Nephelometric Turbidity Units or NTU)

EPA standard is <0.3 NTU in 95% of samples and never >1 NTU in any single sample of finished water.

Year	Raw Water			After Primary Treatment			Plant Tap		
	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min
2015	6.49	79.70	0.42	0.61	1.81	0.23	0.08	0.19	0.06
2014	4.11	61.4	0.17	0.66	2.20	0.21	0.08	0.24	0.07
2013	8.49	85.5	0.49	0.75	2.35	0.06	0.08	0.16	0.07
2012	9.59	124.0	0.55	0.74	2.71	0.25	0.08	0.18	0.06
2011	19.66	143.0	0.54	0.98	4.20	0.06	0.08	0.40	0.06

Raw Water Temperature

Year	Average	Maximum	Minimum
2015	10.2°C / 50.4°F	22.5°C / 72.5°F	0.9°C / 33.6°F
2014	10.0°C / 50.0°F	23.8°C / 74.8°F	0.8°C / 33.4°F
2013	11.2°C / 52.1°F	24.5°C / 76.1°F	0.8°C / 33.4°F
2012	12.9°C / 55.3°F	26.8°C / 80.2°F	2.1°C / 35.8°F
2011	11.3°C / 52.3°F	25.0°C / 77.0°F	0.8°C / 33.4°F

Fluoride Content (EPA standard is 0.9 - 1.2 ppm)

Year	Plant Tap			Distribution		
	Avg	Max	Min	Avg	Max	Min
2015	0.94	1.11	0.21	0.98	1.18	0.75
2014	0.96	1.10	0.22	1.07	1.07	0.90
2013	0.97	1.11	0.90	0.98	1.09	0.90
2012	0.98	1.09	0.90	0.98	1.08	0.90
2011	0.99	1.11	0.90	1.00	1.11	0.90

Chlorine Residual (ppm)

Report of Evanston Water Quality Control Laboratory

Filter Influent

Year	Free Residual			Total Residual		
	Avg	Max	Min	Avg	Max	Min
2015	0.68	1.06	0.46	0.81	1.21	0.109
2014	0.68	1.14	0.42	0.81	1.29	0.52
2013	0.64	0.92	0.35	0.77	1.06	0.49
2012	0.68	1.04	0.44	0.81	1.19	0.54
2011	0.67	0.96	0.42	0.81	1.14	0.49

Filter Effluent

Year	Free Residual			Total Residual		
	Avg	Max	Min	Avg	Max	Min
2015	0.59	0.92	0.39	0.93	76	0.49
2014	0.60	1.04	0.38	0.72	1.19	0.51
2013	0.55	0.83	0.30	0.67	0.97	0.40
2012	0.59	0.92	0.40	0.71	1.04	0.51
2011	0.58	0.86	0.36	0.71	0.99	0.48

Plant Tap

Year	Free Residual			Total Residual		
	Avg	Max	Min	Avg	Max	Min
2015	0.69	0.93	0.5	0.84	1.13	0.62
2014	0.68	1.00	0.51	0.83	1.20	0.61
2013	0.66	0.88	0.46	0.80	1.07	0.60
2012	0.67	1.00	0.48	0.81	1.15	0.60
2011	0.67	0.94	0.49	0.81	1.17	0.62

Distribution Tap

Year	Free Residual			Total Residual		
	Avg	Max	Min	Avg	Max	Min
2015	0.44	0.78	0.17	0.60	0.92	0.3
2014	0.45	0.80	0.17	0.61	1.02	0.31
2013	0.45	0.78	0.18	0.61	0.99	0.34
2012	0.44	0.90	0.13	0.59	1.05	0.30
2011	0.43	0.94	0.15	0.59	0.86	0.28

Phosphate, pH, Alkalinity and Hardness

Report of Evanston Water Quality Control Laboratory

Phosphate (EPA standard is 0.15 - 0.50 ppm)

Year	Number of Tests	Plant Tap		
		Avg	Max	Min
2015	365	0.25	0.35	0.18
2014	365	0.24	0.41	0.19
2013	365	0.21	0.25	0.15
2012	365	0.2	0.38	0.15

pH (EPA standard is 7.1 - 7.9)

Year	Number of Tests	Raw Water			Plant Tap		
		Avg	Max	Min	Avg	Max	Min
2015	730	8.3	8.5	7.9	7.6	7.8	7.3
2014	729	8.3	8.6	8.0	7.6	7.7	7.3
2013	730	8.3	8.5	8.0	7.6	7.9	7.3
2012	732	8.3	8.5	8.1	7.6	7.9	7.6
2011	730	8.3	8.5	8.0	7.6	7.8	7.4

Alkalinity (ppm)

Year	Number of Tests	Raw Water			Plant Tap		
		Avg	Max	Min	Avg	Max	Min
2015	730	106	121	92	100	115	91
2014	730	109.25	134	92	102.43	130	91
2013	730	105	112	94	98	108	90
2012	732	105	112	92	98	108	84
2011	730	106	116	93	99	110	74

Hardness (ppm as CaCO₃)

Year	Number of Tests	Raw Water			Finished Water		
		Avg	Max	Min	Avg	Max	Min
2015	730	135	149	124	133	154	124
2014	730	135.47	149	104	132.66	149	97
2013	730	135	142	111	131	141	119
2012	732	136	149	124	132	149	134
2011	730	135	148	120	133	149	118

Detected Substances: 2015 Water Quality Data

Substance	MCLG	Highest Allowed (MCL)	Highest Level Detected	Range of Levels Detected	Violation	Source of Contamination
Turbidity (NTU) (Cloudiness)	NA	TT=Monitored by % exceeding 0.3 NTU and max allowed is 1 NTU	100% of samples meet 0.3 NTU; 0.19 NTU Highest single measurement	0.06 - 0.19	NO	Soil runoff
Fluoride (ppm)	4	4	1.11	Single Sample	NO	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories.
Nitrate [measured as Nitrogen](ppm)	10	10	0.3	Single Sample	NO	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits
Sodium (ppm)	NA	NA	7.5	Single Sample	NO	Erosion from naturally occurring deposits
Barium (ppm)	2	2	0.02	Single Sample	NO	Discharge of drilling wastes; Discharge from metal refineries; Erosion of Natural deposits
Chromium, Total (ppm)	100	100	0.9	Single Sample	NO	Discharge from steel and pulp mills; erosion of natural deposits
Total Coliform Bacteria	0	5% of Monthly Samples are Positive	2.30%	NA	NO	Naturally present in the environment
Combined Radium 226/228 (pCi/L) ^b	0	5	0.99	Single Sample	NO	Erosion of natural deposits
Gross Alpha excluding Radon and Uranium (pCi/L) ^b	0	15	0.16	Single Sample	NO	Erosion of natural deposits
Cotinine (ppb)	NOT REGULATED	NOT REGULATED	0.001	Single Sample	NO	Nicotine metabolite/waste water discharge
Sulfate (ppm)	NOT REGULATED	USEPA National Secondary Standard of 250	24	Single Sample	NO	Naturally occurring, coagulant residual
Disinfectants and Disinfection By-Products	MCLG	Highest Allowed (MCL)	Highest Level Detected	Range of Levels Detected	Violation	Source of Contamination
Total Trihalomethanes (ppb)	NA	80	23	11.1 - 26.5	NO	By-product of drinking water chlorination
Total Haloacetic Acids (ppb)	NA	60	9	2.9 - 9.2	NO	By-product of drinking water chlorination
Chlorine (ppm)	4 MRLDG	4 MRDL	0.5	0.4 - 0.5	NO	Water additive used to control microbes

Detected Substances: 2015 Water Quality Data

Lead & Copper	MCLG	Action Level (AL)	90th Percentile	Range of Levels Detected	Violation	Source of Contamination
Lead (ppb)	0	15	3.9	<1 - 11	NO	Corrosion of household plumbing systems; Erosion of natural deposits
Copper (ppm)	1.3	1.3	0.14	<0.001 - 0.510	NO	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems

Additional Information About Your Water

Measured Parameter	Evanston Minimum	Evanston Maximum	Measured Parameter	Evanston Result
pH (0-14 pH units)	7.3	7.8	Calcium (ppm)	35
Hardness (as mg CaCO ₃ /L)	124	154	Chloride (ppm)	16
Hardness (gpg)	7.3	9	Dissolved Solids (ppm)	170
Alkalinity (ppm)	91	115	Magnesium (ppm)	12
Raw Water Temperature °F	34	73	Potassium (ppm)	1.6

Non-Detected Contaminants

2015 Water Quality Data

Inorganic Contaminants	MCLG	MCL	UL MRL	Level Found
ARSENIC (ppb)	none	50	1	ND
CADMIUM (ppb)	5	5	1	ND
CHROMIUM (ppb)	200	200	0.01	ND
CYANIDE (ppb)	n/a	1000	0.02	ND
IRON (ppb)	n/a	150	2	ND
MANGANESE (ppb)	2	2	0.1	ND
MERCURY (INORGANIC) (ppb)	n/a	100	1	ND
NICKEL	50	50	2	ND
SELENIUM (ppb)	6	6	1	ND
ANTIMONY (ppb)	4	4	0.3	ND
BERYLLIUM (ppb)	0.5	2	0.3	ND
THALLIUM (ppb)	n/a	5000	5	ND
ZINC (ppb)	n/a	5000	5	ND
NITRITE (AS NITROGEN) (ppm)	1	1	0.01	ND

Synthetic Organic Contaminants

ENDRIN (ppb)	2	2	0.1	ND
BHC- GAMMA (LINDANE)	200	200	0.1	ND
METHOXYCHLOR (ppb)	40	40	0.1	ND
TOXAPHENE (ppb)	0	3	1	ND
DIQUAT (ppb)	20	20	2	ND
DALAPON (ppb)	200	200	5	ND
ENDOTHALL (ppb)	100	100	9	ND
DI(2-ETHYLHEXYL)ADIPATE (ppb)	400	400	0.6	ND
OXAMYL (VYDATE) (ppb)	200	200	2	ND
SIMAZINE (ppb))	4	4	0.35	ND
DI(2-ETHYLHEXYL)PHTHALATE (ppb)	0	6	0.6	ND
PICHLORAM (ppb)	500	500	0.4	ND
DINOSEB (ppb)	7	7	1	ND
HEXACHLOROCYCLOPENTADIENE (ppb)	50	50	0.5	ND
ALDICARB SULFOXIDE	n/a	n/a	1	ND
ALDICARB SULFONE	n/a	n/a	1	ND
CARBOFURAN (ppb)	40	40	0.9	ND
ALDICARB	n/a	n/a	1	ND
ATRAZINE (ppb)	3	3	0.3	ND
ALACHLOR (LASSO)(ppb)	0	2	0.2	ND
HEPTACHLOR	0	100	0.04	ND
HEPTACHLOR EPOXIDE (ppt)	0	100	0.02	ND
DIELDRIN	n/a	1	0.05	ND
2,4-Dichloro-Phenoxyacetic Acid (2,4-D) (ppb)	10	10	1	ND
2,4,5-TP (SILVEX) (ppb)	50	50	1	ND
HEXACHLOROBENZENE (ppb)	0	1	0.1	ND
BENZO (A) PYRENE (ppb)	0	200	0.1	ND
PENTACHLOROPHENOL (PCP) (ppb)	0	1	0.4	ND
ALDRIN (ppb)	n/a	1	0.05	ND
POLYCHLORINATED BIPHENYLS (PCB) (ppb)	0	500	varies	ND
TOTAL DDT (ppb)	n/a	50*	1	ND
1,2 DIBROMO3-CHLOROPROPANE (DBCP) (ppb)	0	0.2	0.02	ND
ETHYLENE DIBROMIDE (EDB) (ppb)	0	50	0.01	ND
CHLORDANE (ppb)	0	2	0.2	ND

Non-Detected Contaminants

2015 Water Quality Data

THM/HAA5	MCLG	MCL	UL MRL	Level Found
MONOBROMOACETIC ACID (ppb)	na	na	1.0	ND

UCMR3 (ppb) collected Feb. & May 2014	MCLG	MCL	UL MRL	Level Found
Chlorate	n/a	n/a	20	ND
1,4 Dioxane	n/a	n/a	0.07	ND
Bromochloromethane	n/a	n/a	0.06	ND
Bromomethane	n/a	n/a	0.2	ND
1,3- Butadiene	n/a	n/a	0.1	ND
Chlorodifluoromethane	n/a	n/a	0.08	ND
Chloromethane	n/a	n/a	0.2	ND
1,1 Dichloroethane	n/a	n/a	0.03	ND
1,2,3, Trichloropropane	n/a	n/a	0.03	ND
Perfluorobutanesulfonic acid (PFBS)	n/a	n/a	0.09	ND
Perfluoroheptanoic acid (PFHpA)	n/a	n/a	0.01	ND
Perfluorohexanesulfonic acid (PFHxS)	n/a	n/a	0.03	ND
Perfluorononanoic acid (PFNA)	n/a	n/a	0.02	ND
Perfluorooctane sulfonate (PFOS)	n/a	n/a	0.04	ND
Perfluorooctanoic acid (PFOA)	n/a	n/a	0.02	ND
Cobalt	n/a	n/a	1	ND

Unregulated Contaminants	MCLG	MCL	UL MRL	Level Found
Bisphenol A (ppb)	na	na	0.1	ND
Nonylphenol, isomer mix (ppb)	na	na	0.5	ND
4-n-Octylphenol (ppb)	na	na	0.5	ND
4-tert-Octylphenol (ppb)	na	na	0.5	ND
Pentachlorophenol (ppb)	na	na	0.1	ND
Phenylphenol (ppb)	na	na	0.1	ND
Tetrabromobisphenol A (ppb)	na	na	0.1	ND
2,4,6-Trichlorophenol (ppb)	na	na	0.1	ND
Pharmaceutically Active Compounds Positive	na	na	varies	ND
Pharmaceutically Active Compounds Negative	na	na	varies	ND

MCL= Maximum Contaminant Level

MCLG = Maximum Contaminant Level Goal

UL MRL= Underwriters Laboratories Minimum Reporting Level

ND = Not Detected

Lead and Copper Statement

Report of Water Quality Control Laboratory

There is no detectable lead in the water produced by the City of Evanston's water treatment plant. Lead enters the water from lead solder and/or lead pipes in water services, or through plumbing fixtures. To minimize contamination resulting from corrosion, the EPA established a lead action level of 15 parts per billion (ppb) in 1992. The 90th percentile result of samples analyzed for lead and copper content in homes with lead pipes must be less than the action levels of 15 ppb and 1.3 ppm, respectively.

Lead and copper sampling is performed every three years in compliance with state law. In 2014, Evanston sampled water from 30 homes with lead service lines and analyzed them for lead and copper content. All results were below the action levels. The 90th percentile level for lead in these samples was 3.9 ppb. The 90th percentile level for copper was 0.14 ppm.

Definitions and General Explanations

Action Level – The concentration of a contaminant, which, if exceeded, triggers treatment or other required actions by the water supply.

Disinfection By-Products – Total Trihalomethanes and Total Haloacetic Acids are used to regulate the amount of allowable by-products of chlorination.

EPA – Environmental Protection Agency

Fluoride – The Illinois Department of Public Health recommends an optimal fluoride range of 0.9 to 1.2 ppm

Lead and Copper – There is no detectable lead in the water provided to the Evanston community. Lead enters the water from lead solder, lead pipes, or plumbing fixtures. To minimize contamination resulting from corrosion, the EPA established a lead action level of 15 parts per billion (ppb) in 1992. The 90th percentile result of samples analyzed for lead and copper content in homes with lead pipes must be less than the action level of 15 ppb and 1.3 ppm respectively.

MCL – Maximum Contaminant Level, the highest level of a contaminant that is allowed in drinking water. A MCL is set as close to a MCLG as feasible using the best available treatment technology.

MCLG – Maximum Contaminant Level Goal, the level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

mg CaCO₃/L – milligrams of calcium carbonate per liter.

mrem/yr – Millirems Per Year. A measure of radiation absorbed by the body.

MRDL – Maximum Residual Disinfection Level. The highest level of disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

MRDLG – Maximum Residual Disinfection Level Goal. The level of disinfectant in drinking water below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

NA – Not applicable.

NTU – Nephelometric Turbidity Units. A measure of the cloudiness of water.

pCi/L – Picocuries per liter. A measure of radioactivity.

ppm – Parts per million. A measure of the concentration of a substance in water. An equivalent unit of measurement is milligrams per liter (mg/L).

ppb – Parts per billion. A measure of the concentration of a substance in water. An equivalent unit of measurement is micrograms per liter (µg/L).

Sodium – There is not a state or federal MCL for sodium. Sodium levels below 20 mg/L (ppm) are not considered to be a public health issue.

TT – Treatment Technique. A required process to reduce the level of a contaminant.

Turbidity – A measurement of the cloudiness of the water caused by suspended particles. This is monitored because it is a good indicator of water quality as well as the effectiveness of the filtration and disinfection processes.

TOC – Total Organic Carbon. The Evanston Water Supply monitored the percentage of TOC removal quarterly and met all TOC removal requirements set by the EPA.

Distribution

The Distribution Division manages operation, maintenance, and repair of Evanston's water mains, valves, fire hydrants, and the City's portion of water service lines. This includes repairing water main breaks and water service leaks; and installing new valves, hydrants, and water mains to improve the operation and efficiency of Evanston's water distribution system. Annual maintenance programs administered by this division include water main leak surveying, valve exercising, and fire hydrant testing. The Distribution Division also performs routine water quality sampling in buildings throughout Evanston, and administers the City's cross connection control program. These two programs ensure that water remains safe to drink after leaving the water treatment plant.

Evanston has had a water distribution system since the 1870s, longer than most communities in the Chicago area. The original water mains were made of wood, with a transition to cast iron water mains by the 1890s. After completion of the water treatment plant in 1914, the plentiful supply of safe drinking water drew many new residents and businesses to Evanston. The distribution system underwent significant expansion over the next few years, and many of those 90 to 100+ year-old water mains are still in operation today. Evanston manages an annual water main renewal program to replace and rehabilitate old water mains as they develop maintenance problems.



A Distribution Division field crew installing a new fire hydrant connection on a 24" diameter water main, to improve the City's ability to clean and test this main.





Pieces of wood water main from Evanston's original water distribution system.

Fire Hydrants System Data and Maintenance*

Fire Flow Testing	2011	2012	2013	2014	2015**
Fire Department	1,410	1,400	1,417	1,100	1,477
Public Works Agency	126	42	22	0	0

Installation & Maintenance	2011	2012	2013	2014	2015
Installed (new)	19	10	18	12	11
Replaced	22	17	22	15	13
Repaired	176	73	175	315	51

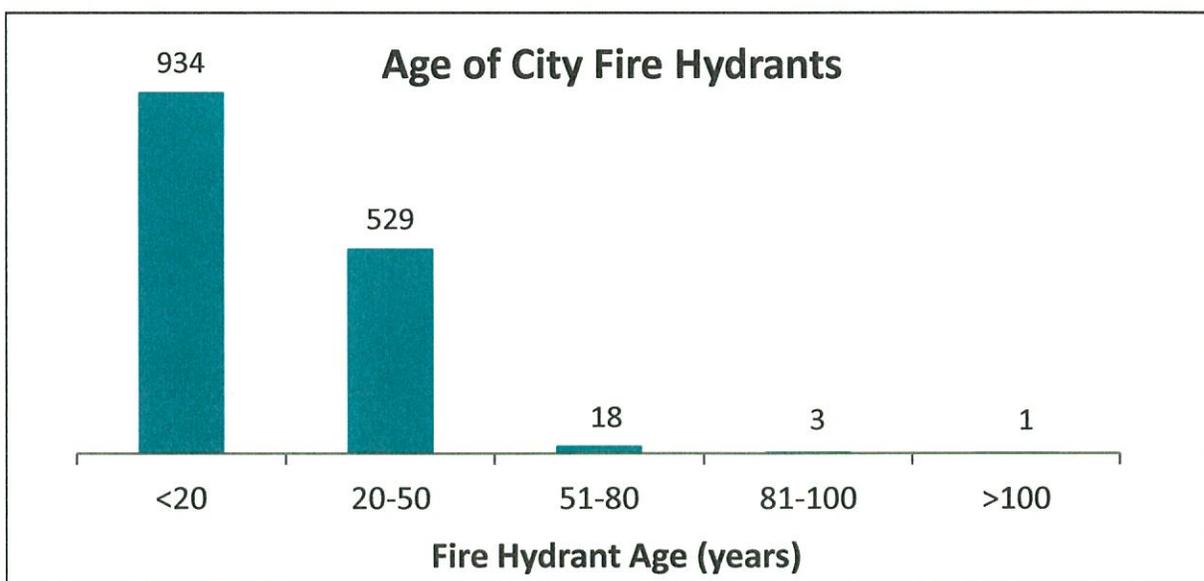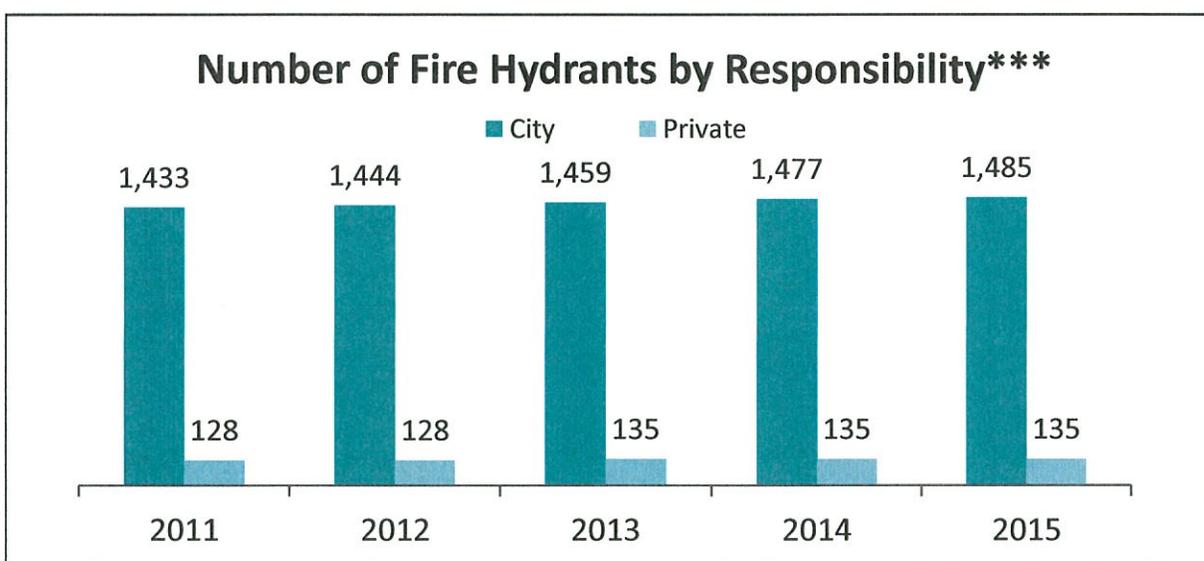

* All work completed by Public Works Agency staff unless otherwise noted.

** Testing was limited to avoid impacting water pressure during transmission main improvements.

*** Changes due to hydrant removal/addition during water main improvements and utility atlas updates.


Water Distribution System Valves

System Data and Maintenance*

Testing & Inspection	2011	2012	2013	2014	2015
In-House	807	1,071	1,117	910	908
Contractor	0	0	0	0	0

Installation & Maintenance	2011	2012	2013	2014	2015
Installed (new)	10	11	14	14	13
Replaced	25	26	44	34	16
Repaired	24	38	41	19	55

Number of Valves by Size	2011	2012	2013	2014	2015
4" or smaller	31	30	28	23	23
6"	1021	1011	996	979	975
8"	469	484	492	507	513
10"	183	185	183	189	192
12"	227	235	243	243	244
14"	2	2	2	2	2
16"	49	49	46	50	50
18"	4	4	4	5	5
20"	1	2	2	2	2
24"	30	30	33	33	33
30"	11	11	12	12	12
36"	12	12	12	12	12
42"	2	2	2	2	2
48"	2	2	2	2	2
Total	2,044	2,059	2,057	2,061	2,067

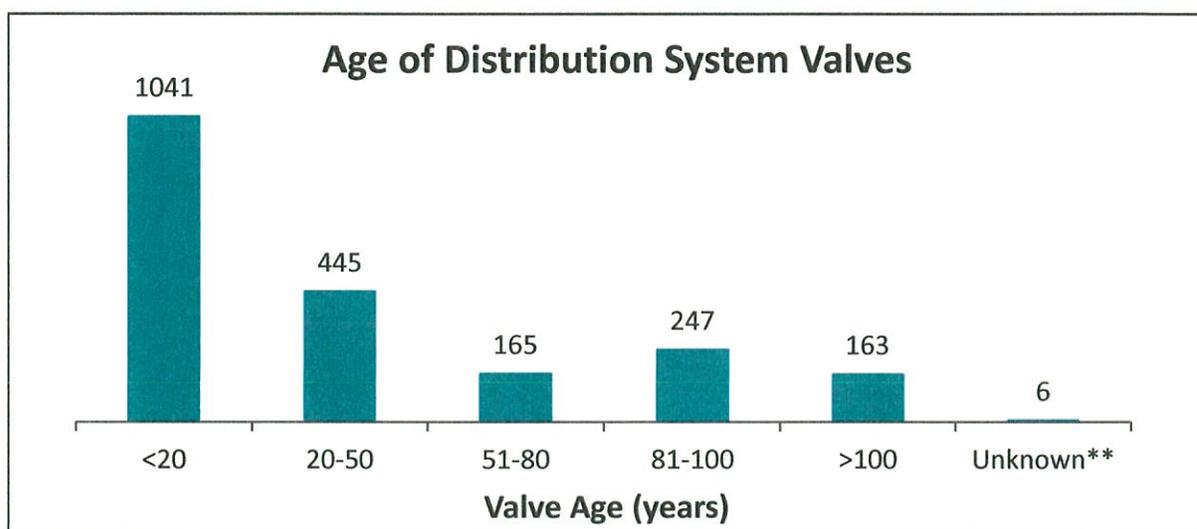

* All work completed by Public Works Agency staff unless otherwise noted.

** Valves are buried beneath paved surfaces and are not accessible for field verification of age.


Water Mains

System Data and Maintenance*

Improvements (lineal feet)	2011	2012	2013	2014	2015
Replaced by City	0	181	50	0	0
Replaced by Contractor	7,235	9,868	8,870	8,526	4,303
Rehabilitated by Contractor	0	0	0	569	395

Water Main Break Repairs	2011	2012	2013	2014	2015
Blow-Out	16	56	21	32	5
Shear Break	11	8	30	36	18
Damage	0	2	3	2	0
Total	27	66	54	70	23

Pipe Sizes (length in miles)**	2011	2012	2013	2014	2015
4" or smaller	2.10	1.83	1.67	1.37	1.37
6"	77.49	76.02	74.99	72.99	73.26
8"	26.69	27.62	28.35	28.81	28.93
10"	12.46	12.47	12.30	12.76	12.81
12"	16.88	17.42	17.73	17.51	17.66
14"	0.37	0.37	0.37	0.37	0.37
16"	6.35	6.51	6.25	6.26	6.26
18"	0.83	0.83	0.83	0.83	0.83
20"	0.56	0.56	0.56	0.56	0.56
24"	8.30	8.30	8.60	8.60	8.60
30"	1.69	1.69	1.69	1.69	1.69
36"	3.30	3.30	3.30	3.30	3.30
42"	0.04	0.04	0.04	0.04	0.04
48"	0.68	0.68	0.68	0.68	0.68
Total	157.73	157.63	157.35	155.77	156.36

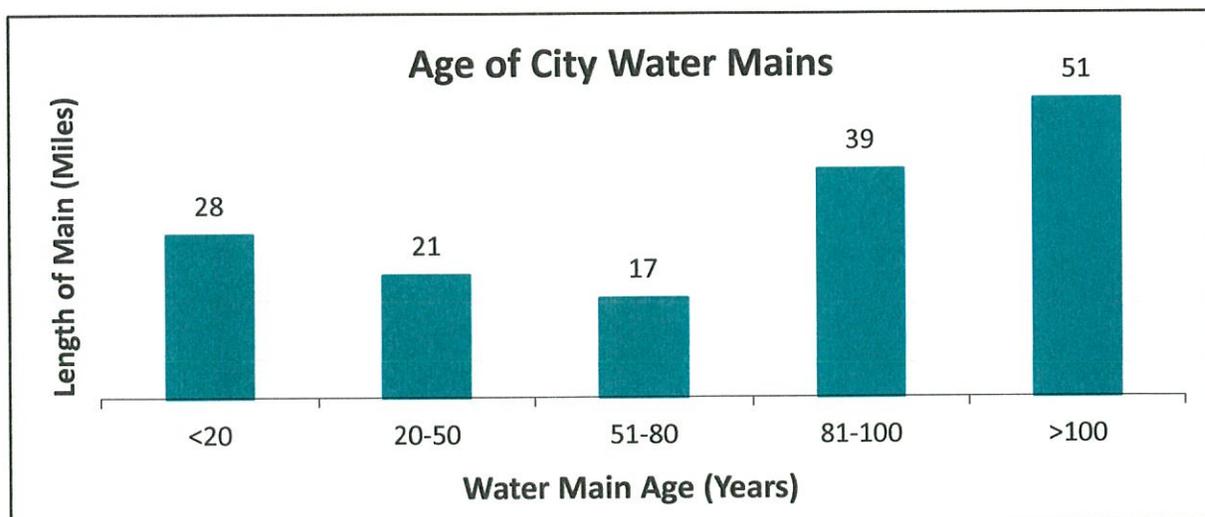

* All work completed by Public Works Agency staff unless otherwise noted.

** Changes due to water main removal/addition during improvement projects and utility atlas updates.

Water Services


System Data and Maintenance*

Water Service Accounts: 14,997 (metered domestic services + unmetered fire services)

Installation & Maintenance	2011	2012	2013	2014	2015
New Services Installed	19	4	2	19	13
Service Taps Replaced***	-	55	28	33	36
Services Replaced by Contractor	-	-	188	124	147
Service Leaks Repaired	22	14	34	36	22

Breakdown of In-House Maintenance Costs

	2011	2012	2013	2014	2015
Water Mains	\$145,934	\$274,946	\$213,075	\$322,859	\$83,864
Fire Hydrants	\$207,625	\$95,065	\$109,048	\$42,398	\$65,197
Water Services	\$211,007	\$135,193	\$159,592	\$293,347	\$166,275
Valves	\$76,172	\$102,763	\$128,645	\$43,665	\$148,309
Snow & Ice Removal	\$59,479	\$24,085	\$42,384	\$74,519	\$46,314
Assist Contractor	\$43,969	\$70,848	\$69,516	\$71,591	\$57,511
JULIE Locates	\$58,975	\$62,845	\$73,519	\$71,911	\$108,200
Equip/Facility Maint.	\$85,559	\$62,757	\$85,631	\$62,051	\$77,189
Assist Other City Depts.	\$21,390	\$16,053	\$11,364	\$25,509	\$8,878
Assist W&S Divisions	\$11,433	\$13,739	\$10,811	\$5,581	\$20,610
Safety & Training	\$19,270	\$10,853	\$18,883	\$17,207	\$22,639
Misc.	\$10,337	\$25,370	\$45,422	\$88,294	\$48,069
Total	\$951,150	\$894,518	\$967,890	\$1,118,932	\$853,054

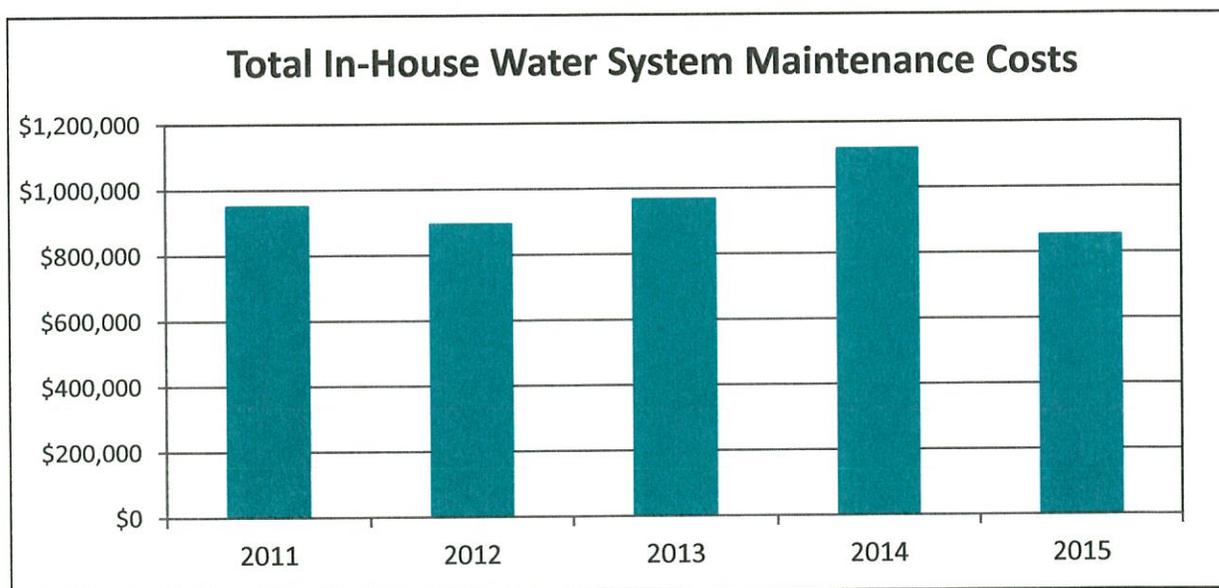

* All work completed by Public Works Agency staff unless otherwise noted.


** Includes metered domestic water service accounts and unmetered fire service accounts.

*** Differentiation of replacement of existing water services from new water service installations began in

Water Main Improvements

The Public Works Agency manages an annual water main improvement program, with the goal of renewing at least 1.5 miles of water mains annually (1% annual system-wide renewal rate). This program addresses water mains that have developed maintenance problems due to their age, as well as water mains that need to be enlarged to satisfy current fire flow requirements.


Water Mains Installed or Rehabilitated

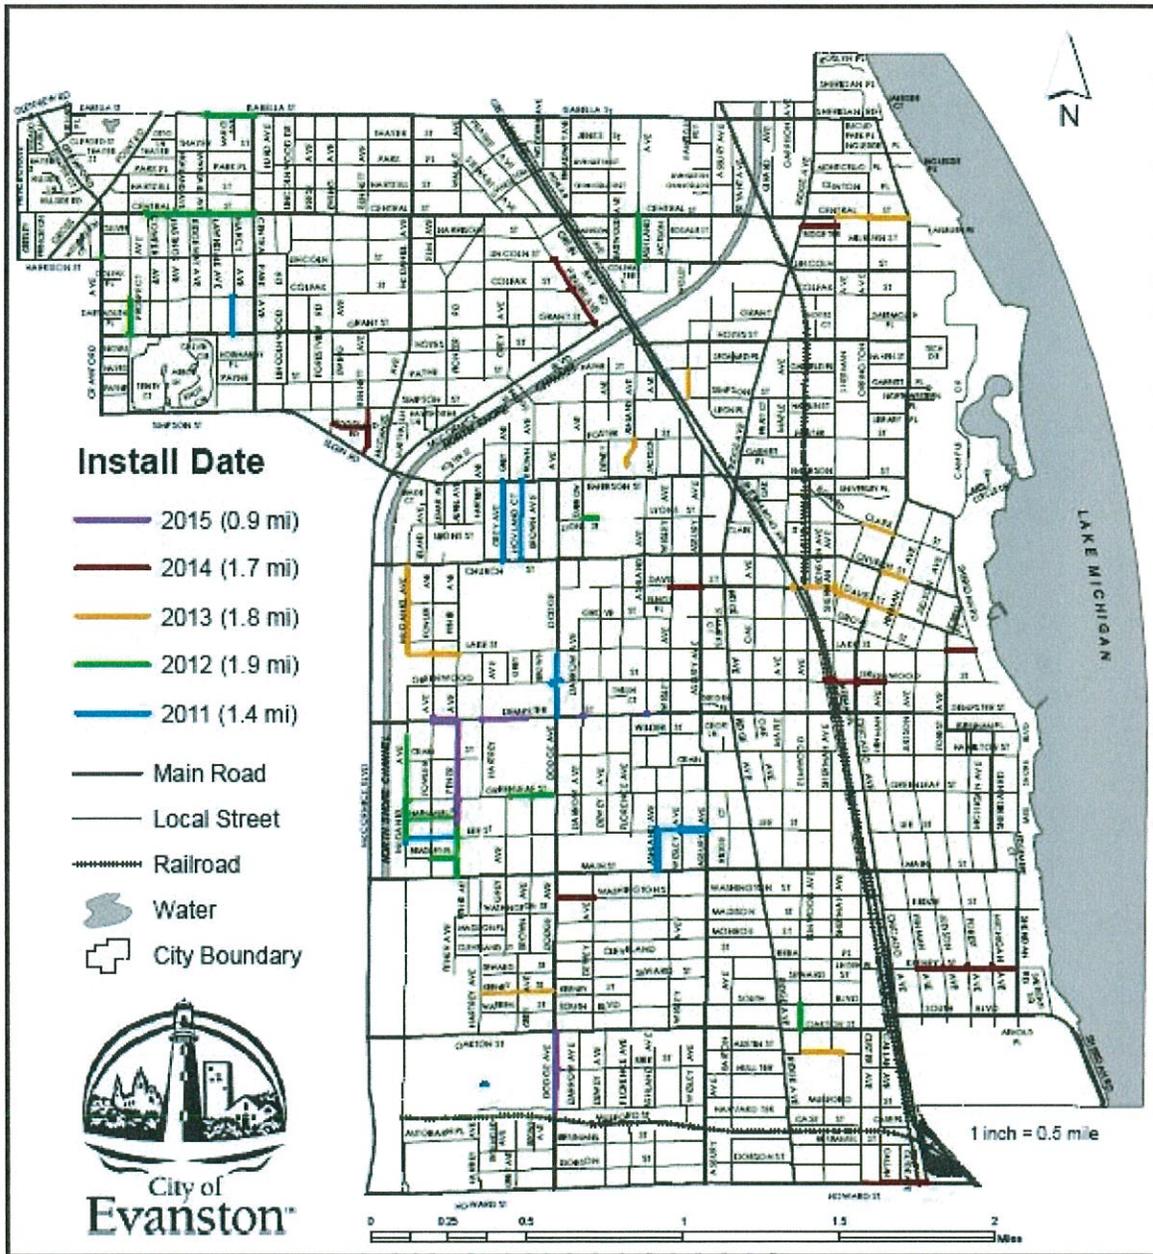

Leak Detection Program

In 2013, the Public Works Agency developed a City-wide surveying program to catch water main leaks early and minimize our water loss. This saves operating costs to produce the water, conserves a vital natural resource, and allows more water mains to be repaired proactively rather than on an emergency basis.

The Public Works Agency uses leak noise loggers, small transmitters that sense the sound waves created by water escaping through a hole in a water main, to test water mains for leaks throughout the year. This proactive leak surveying program began in 2013, and water distribution crews were able to survey all 157 miles of Evanston's water mains in 2013-2014.

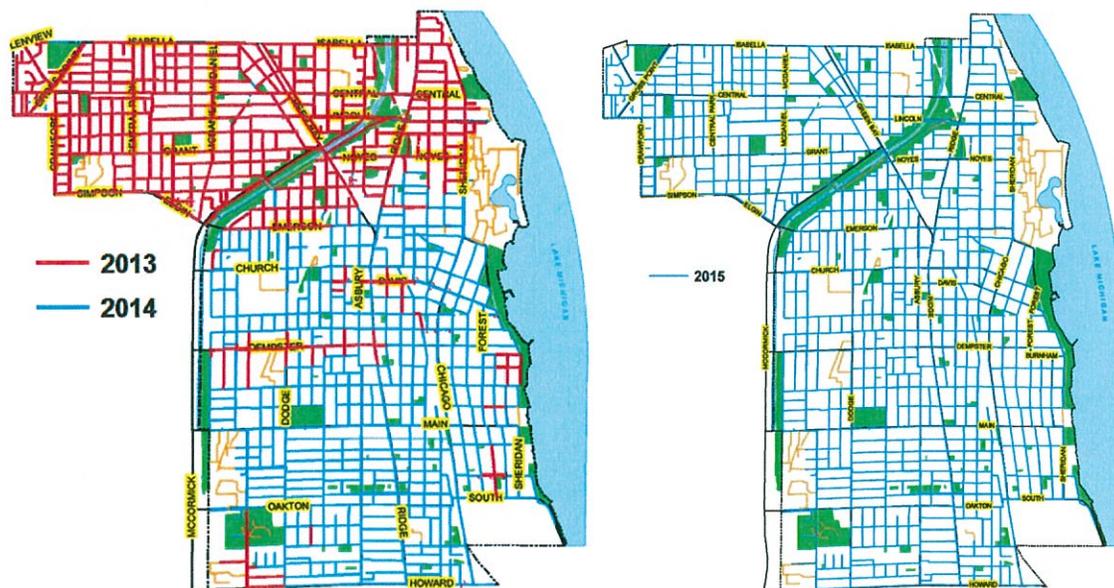

The 2013-2014 surveys found five leaks on building water service pipes and three breaks on water mains. These defects were all successfully repaired, and the estimated water savings is over 15 million gallons (MG) per year.

Year	Miles of Water Main Surveyed	Water Service Leaks Found	Water Main Breaks Found	Water Savings After Repairs
2013	59	1	2	8.85 MG/year
2014	98	4	1	6.26 MG/year
2015	135	3	2	9.90 MG/Year
Totals	292	8	5	25.01 MG/year

In 2015 and future years, the Public Works Agency anticipates being able to survey the entire 157 miles of water mains in Evanston every year. This frequency is important since water main breaks and leaks can develop at any time; a water main that shows no signs of leakage one year can develop a large leak by the next year.

Cross Connection Control


A cross connection is a point in a plumbing system where the potable (safe, drinkable) water supply is connected to a non-potable (polluted or untreated) source. A cross connection exists whenever the drinking water system is or could be connected to any non-potable source. If cross connections are not properly protected and there is a drop in pressure, untreated sources and dirt can be pulled into household plumbing systems.

The State of Illinois and the City of Evanston require mandatory backflow protection on certain households and facilities where high health-hazard-type cross connections are normally found. Underground lawn sprinkling systems, fire protection systems, hospitals and health clinics, mortuaries, laboratories, food and beverage processing and car washes are just a few of the locations where backflow prevention is necessary to protect the quality of our public water supply.

In 2008, the Public Works Agency hired a plumbing inspector to manage the City's cross connection control program. Since that time, over 3,000 backflow prevention devices have been added to the City's inventory and are now regularly inspected for compliance with State and City codes. An annual tracking system enables the City to ensure these devices are properly maintained throughout their life cycle. This helps keep the high quality drinking water produced by the City's water treatment plant safe to drink after entering the water distribution system.

Year	Backflow Prevention Devices Certified Annually
2011	2,609
2012	2,786
2013	3,356
2014	3,644
2015	4,039

Breakdown of Backflow Prevention Devices Certified in 2015

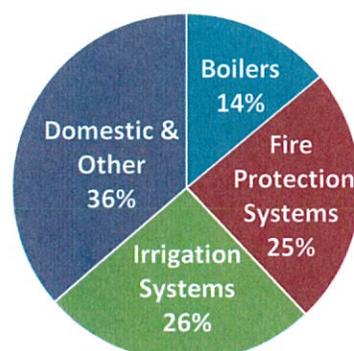

Metering

The Meter Division manages water meter reading and billing for Evanston's 14,500 retail water and sewer customers, working with the City's Collector's Office to process water/sewer bill payments and cross connection control fees. The Meter Division also coordinates with the Distribution Division to manage replacement of damaged and obsolete water meters, accuracy testing for large water meters, and water service shutoff and restoration. In 2013-2014, the Meter Division managed Evanston's migration to a new Advanced Metering Infrastructure (AMI) system, which has improved accuracy and efficiency of the water metering and billing processes. The AMI system also generates automated hourly meter reads and leak alerts for customers to help reduce water loss.

Evanston has been metering water consumption since at least the early 1920s, well before many communities in the Chicago area. Water rates established to pay for the 1914 water treatment plant were only \$0.16 per 1,000 gallons of metered water use! The City originally sent meter reading staff into every building in the City once a quarter to manually read water meters. Water metering technology has evolved considerably over the last 100 years. Current technology allows meter readings to be taken automatically every hour, with once-daily, wireless upload of readings to a computerized billing system.




A Public Works Agency employee installs a new remote water meter reading unit on the exterior of a home as part of the Advanced Metering Infrastructure (AMI) project. This unit makes it possible for meter readings to be transmitted via wireless network without City staff having to visit each property to manually read the meters.



Evanston's first female water meter readers, Dorothy Jay (left) and Marjorie Nantkes (right). They were hired in 1943 to replace men serving in World War II.

Automatic Metering Infrastructure (AMI) System

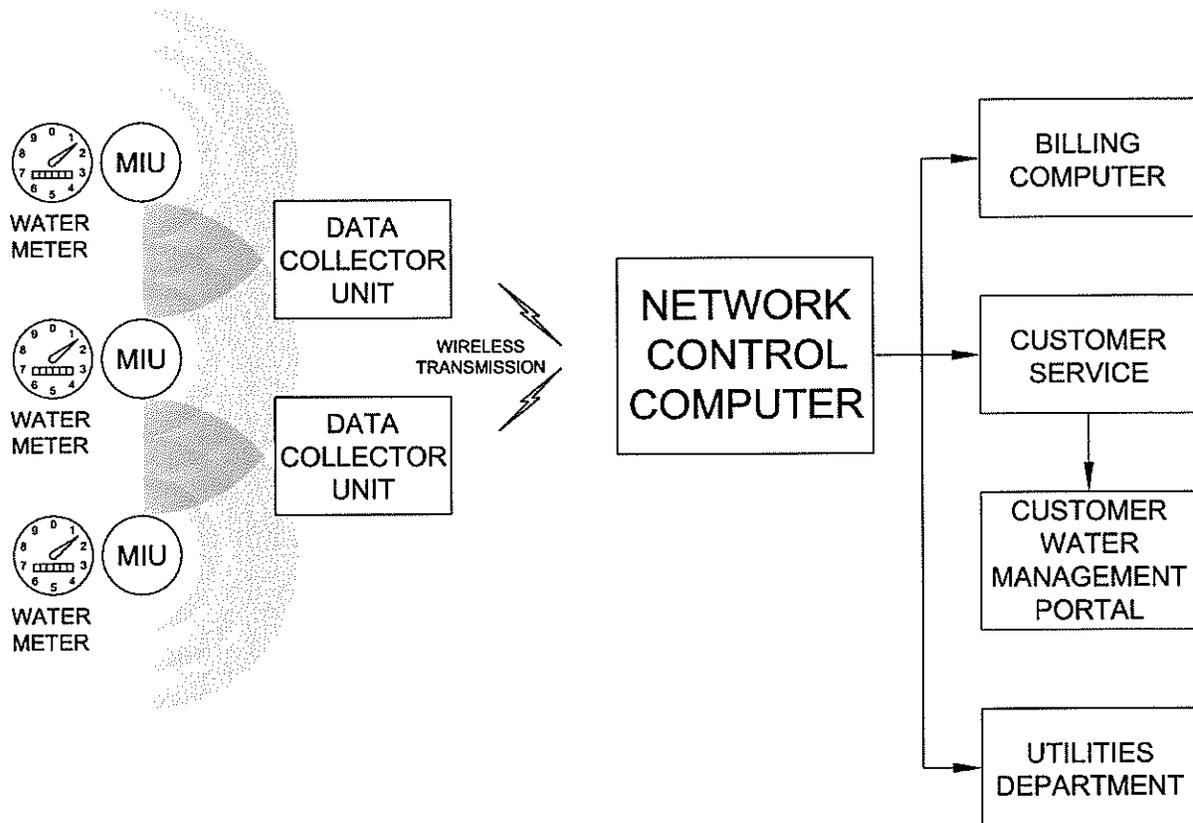

How it works:

- A Meter Information Unit (MIU) is attached to every water meter in Evanston. The MIU takes a meter reading once an hour and stores these readings for a full day. Each MIU broadcasts the readings once a day using a wireless transmitter.
- The Data Collector Unit (DCU) receives the meter readings from the MIUs. Evanston currently has 6 DCUs located on various buildings throughout the community. Each DCU sends its meter reading information to the Network Control System at the Water Treatment Plant on a daily basis.
- The Network Control System supports customer service and system management activities. It transfers the meter readings to the billing system to generate bi-monthly water and sewer bills for Evanston customers.
- The Network Control System monitors fluctuations in water usage, and sends leak alerts to the network administrator if a customer's real-time meter readings are significantly higher than historical usage trends.
- The AMI system includes an online portal where Evanston customers can monitor their water usage, compare usage trends under various weather conditions, and set up leak alerts of their own.

Transmitter Tower Locations



Water Meter Inventory

Water is billed bi-monthly in units of 100 cubic feet (CCF). The minimum service charge every two months is based on water meter size as follows:

Meter Size	Number of Meters
5/8"	11715
3/4"	914
1"	1076
1.5"	253
2"	506
3"	55
4"	25
6"	3
8"	4
Total	14,543

Water Rates for Evanston Customers

Water is billed bi-monthly in units of 100 cubic feet (CCF). The minimum service charge every two months is based on water meter size as follows:

Meter Size	Minimum Charge Effective 1/1/2015
5/8" & 3/4"	\$7.78
1"	\$15.53
1 1/2"	\$29.07
2"	\$45.77
3"	\$80.61
4"	\$129.13
6"	\$227.72
8"	\$385.46




The minimum demand charge includes the first five cubic feet (5 CCF) of water consumed every two months, which is roughly equivalent to 3,740 gallons of water.

Water usage over the minimum is billed at \$2.18 per CCF effective 1/1/2015. This is equivalent to a rate of \$2.91 per 1,000 gallons.

Water Customer Classes and Metered Usage Billed by Category and Water Usage for 2015

Category	Number of Accounts	2015 Usage (CCF)*
Metered Water Services		
Single-Family	10,783	949,824
Multi-Family	2,636	1,148,336
Commercial	979	1,045,791
Industry	35	10,772
City	31	15,221
Park	53	6,632
School	34	33,632
Subtotal	14,551	3,210,208
Unmetered Water Services		
Fire Services**	472	-
Totals	15,023	3,210,208


Water Service Accounts by Category:

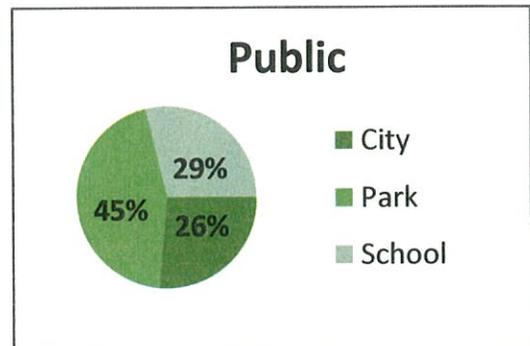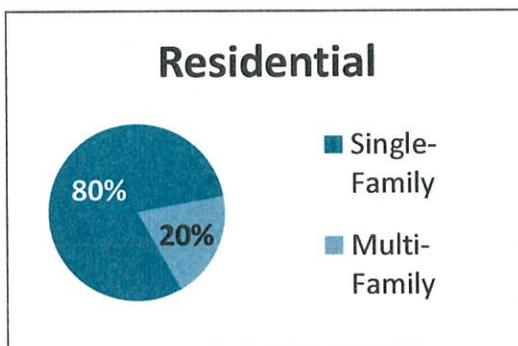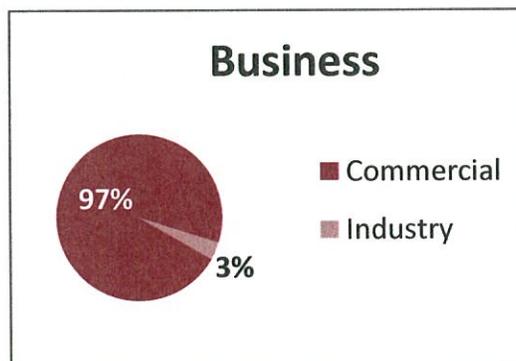

* Water usage is metered in units of 100 cubic feet (CCF). 1 CCF is approximately 748 gallons

** Fire services are not metered. They are billed a flat charge twice per year.

Water Usage Breakdown for Evanston Customers

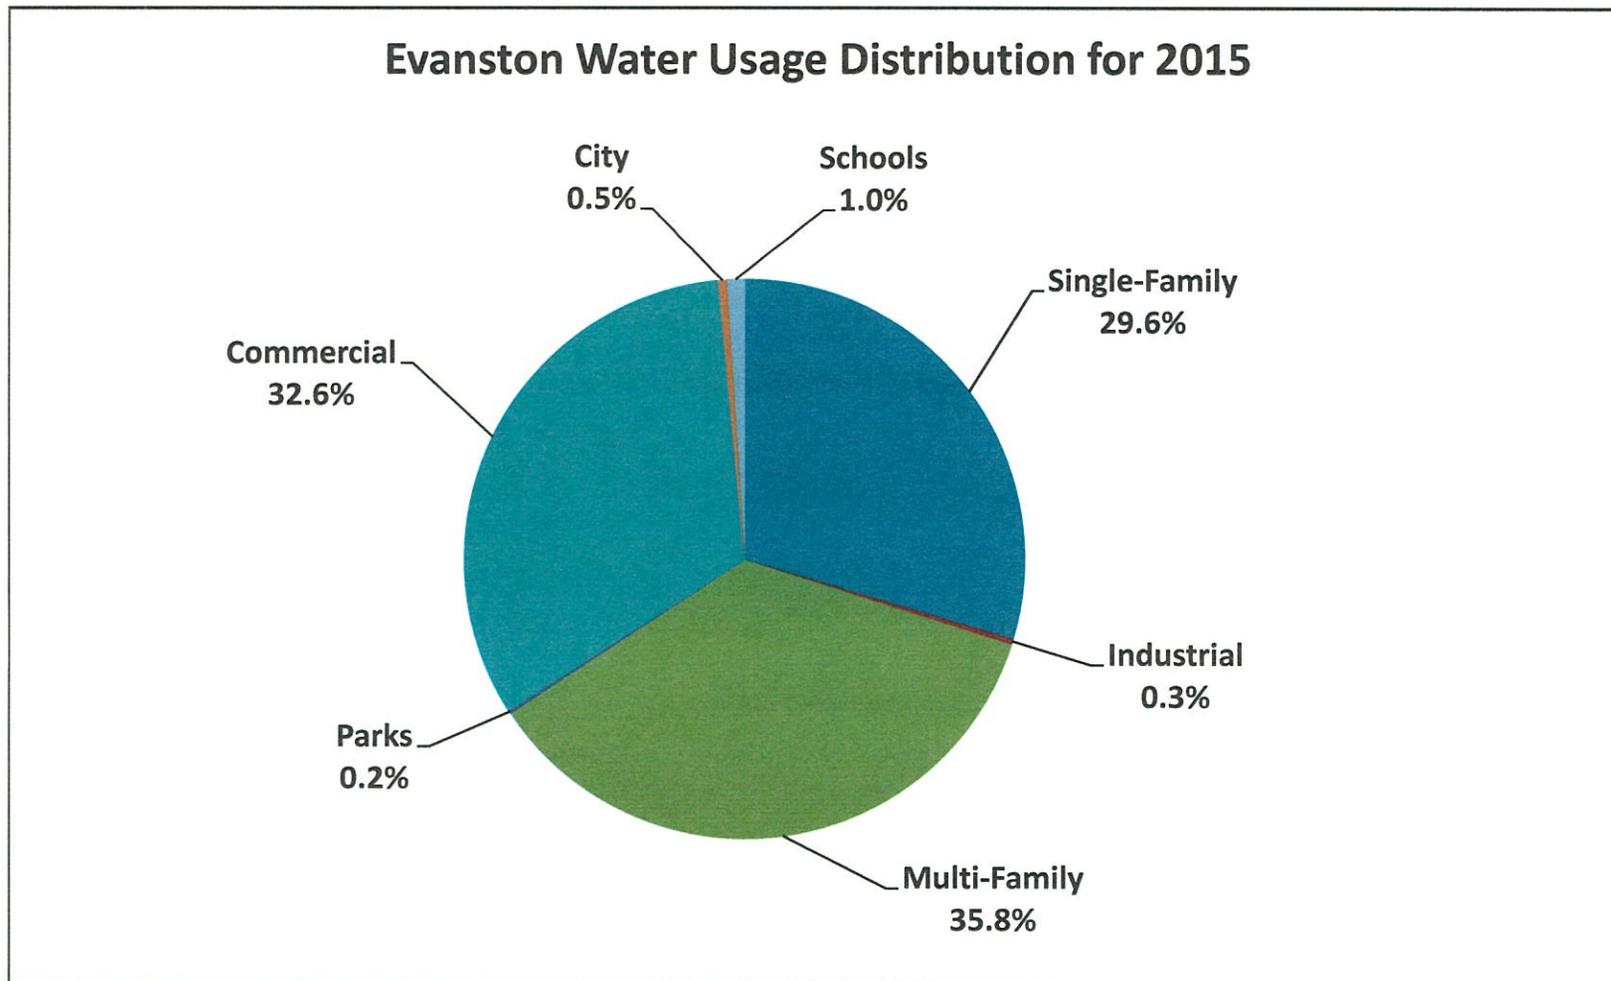

Sewer

The Sewer Division manages the operation, inspection, maintenance, and repair of the City's sewer mains and structures (sewer manholes, catch basins, and stormwater inlets). This includes proactive programs such as sewer main and drainage structure cleaning, root cutting, and televised internal sewer main inspection; as well as responding to all reports of sewer backups and flooding. This division also inspects work done by contractors including sewer main lining and manhole rehabilitation. Sewer Division staff conduct regular inspection of sewer outfalls and other facilities throughout Evanston for compliance with the City's sewer system operating permits with the Illinois Environmental Protection Agency.



Sewer Division staff operate a sewer cleaning truck to remove debris from a catch basin.


Much of Evanston's sewer system was constructed in the late 1800s to early 1900s. These pipes are far too small to convey both domestic sewage and stormwater runoff as they were intended to do. Beginning in the early 1990s, Evanston constructed a network of relief sewers, which are much larger and deeper than the original combined sewers. The relief sewers now convey most of the stormwater runoff, to avoid overwhelming the combined sewers during rain events. The relief sewers run to a number of drop shafts located along the North Shore Channel, where they discharge directly to the Metropolitan Water Reclamation District's (MWRD) deep tunnel system.



This drop shaft was one of the starting points for a tunneling machine that installed Evanston's relief sewers as a part of the Long Range Sewer Program in 1992 – 2008. Relief sewers are installed at depths of up to 60 feet to efficiently collect and transport large volumes of stormwater without impacting customers and other utilities.

Sewer Revenues*

	2014	2015
Operations	\$13,072,700	\$12,276,650
Debt Proceeds	\$1,600,000	\$0
Investment Earnings	\$1,000	\$1,000
Miscellaneous**	\$4,165	\$4,165
Total Sewer Revenue	\$14,677,865	\$12,281,815

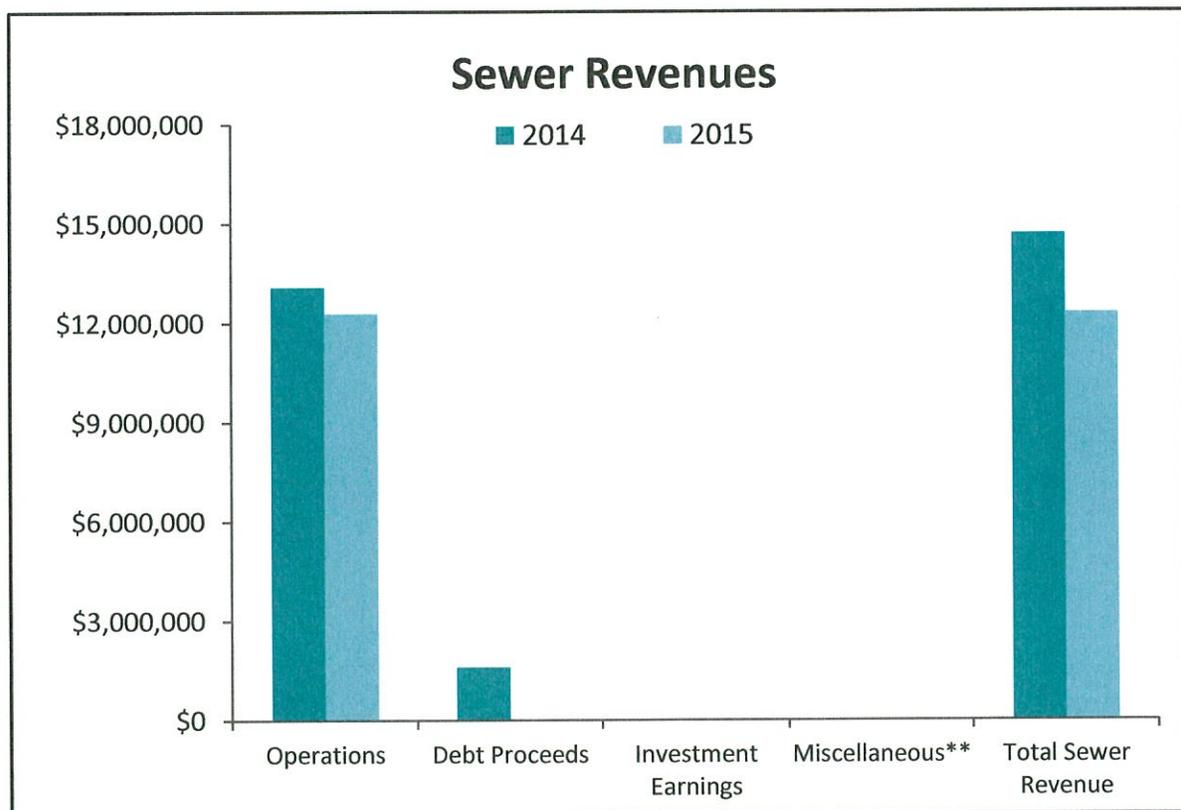


* Financial data are based on actual expenses and do not include audit adjustments such as depreciation and inventory. For audited financial records, see the Comprehensive Annual Financial Report for the City of Evanston, <http://www.cityofevanston.org/transparency/budget-financial-reports/>.

** Miscellaneous Revenue includes fees, grants, and merchandise sales.

Sewer Operating & Maintenance Expenses*

	2014	2015
Sewer Operations	\$2,238,775	\$1,802,652
Other Oper. Expenses	\$24,100	\$6,611
Interfund Transfers	\$622,316	\$818,608
Capital Outlay	\$47,500	\$581,270
Annual Rehab Programs**	\$2,635,000	\$1,002,000
Debt Service	\$10,009,059	\$9,613,727
Total	\$15,576,750	\$13,824,868

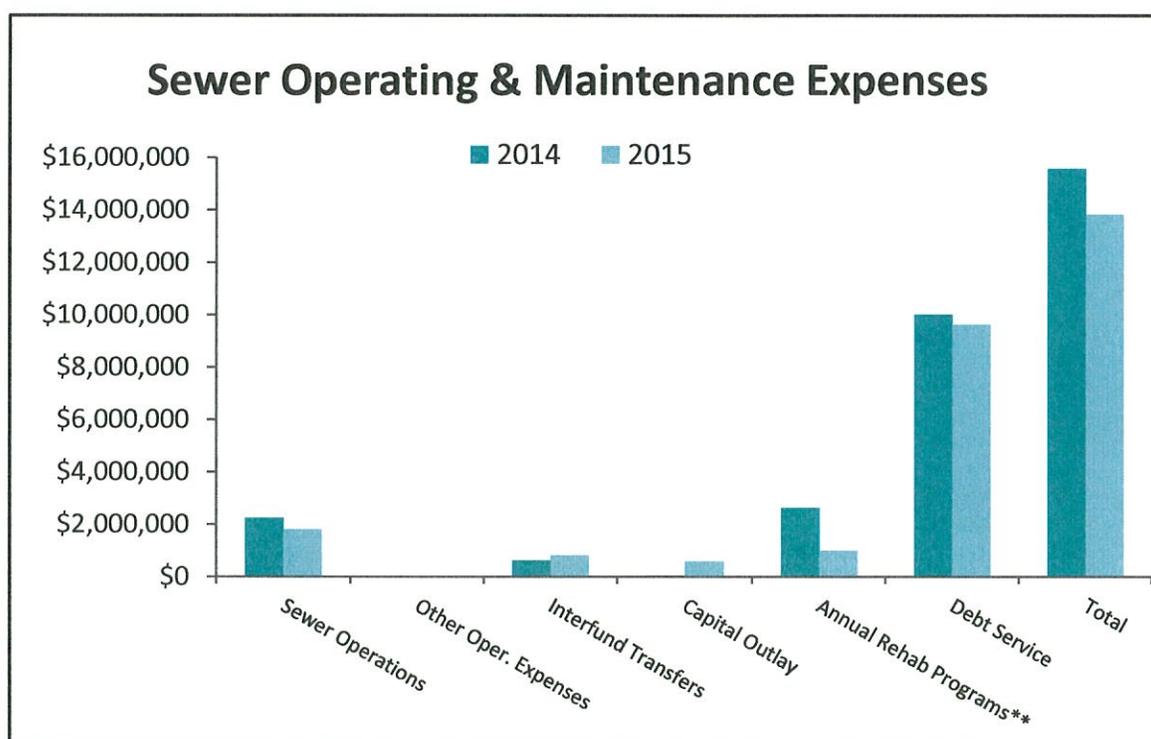


* Financial data are based on actual expenses and do not include audit adjustments such as depreciation and inventory. For audited financial records, see the Comprehensive Annual Financial Report for the City of Evanston, <http://www.cityofevanston.org/transparency/budget-financial-reports/>.

**Includes CIPP sewer rehabilitation, drainage structure replacement, stormwater management improvements, and emergency sewer repairs


Major Combined Sewer System

The combined sewer system is Evanston's original sewage collection system. Much of this system was constructed in the late 1800s to early 1900s. The system was intended to capture and convey both domestic sewage and stormwater runoff, though as early as the early 1900s the City experienced flooding and basement backups during rain storms because the combined sewer pipes were not large enough to handle stormwater. In the early 1990s, Evanston began constructing a relief sewer system to convey the majority of the stormwater runoff and lessen the risk of basement backups.

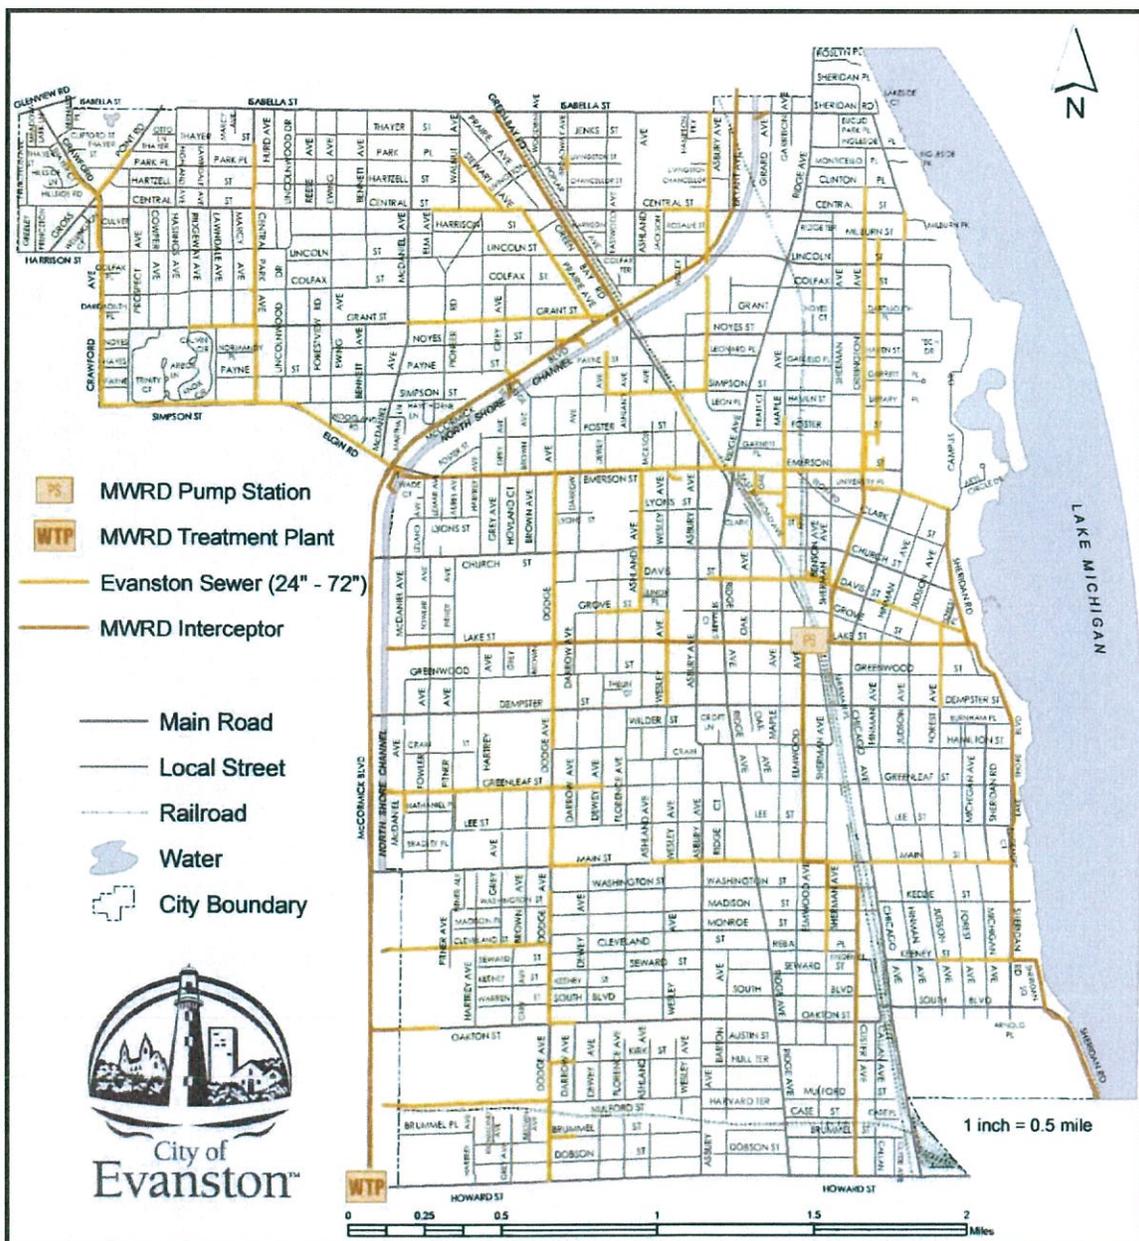


Major Relief Sewer System

Starting as long ago as 1902, property owners in Evanston experienced sewage backing up into basements during significant rain events. In 1990, the City Council approved a Long Range Sewer Improvement Program to mitigate property damage caused by basement backups. As part of this program, a network of large diameter relief sewers was constructed between 1991 – 2008 at a cost of \$210 million. These pipes are larger and deeper than the combined sewers, and convey stormwater runoff and sewage overflows to avoid overwhelming the combined sewers.

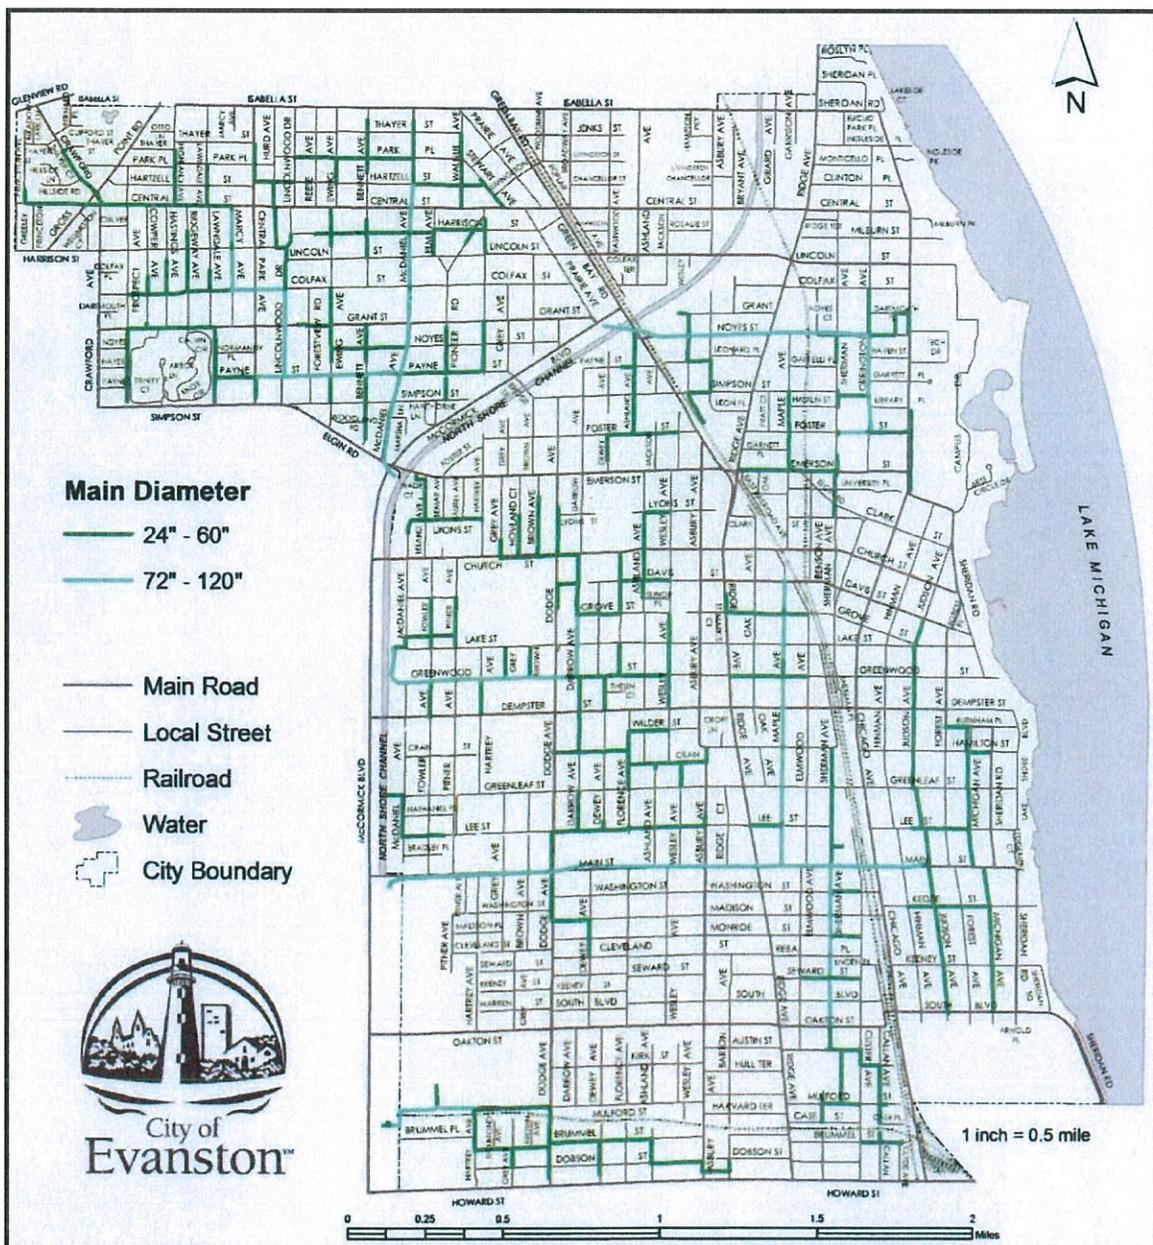

Major Storm Sewer System

The storm sewer system discharges directly to the North Shore Channel and Lake Michigan. It is only utilized during rain events to convey stormwater from the streets to the channel or the lake. Most of the storm sewers in southwest Evanston were installed in the late 1970s to early 1980s. The remainder of storm sewers in this area, as well as the storm sewers in north central and northeast Evanston, were installed between 1991-2008 as part of the Long Range Sewer Improvement Program. Evanston operates the storm sewer system under a special permit issued by the Illinois Environmental Protection Agency.

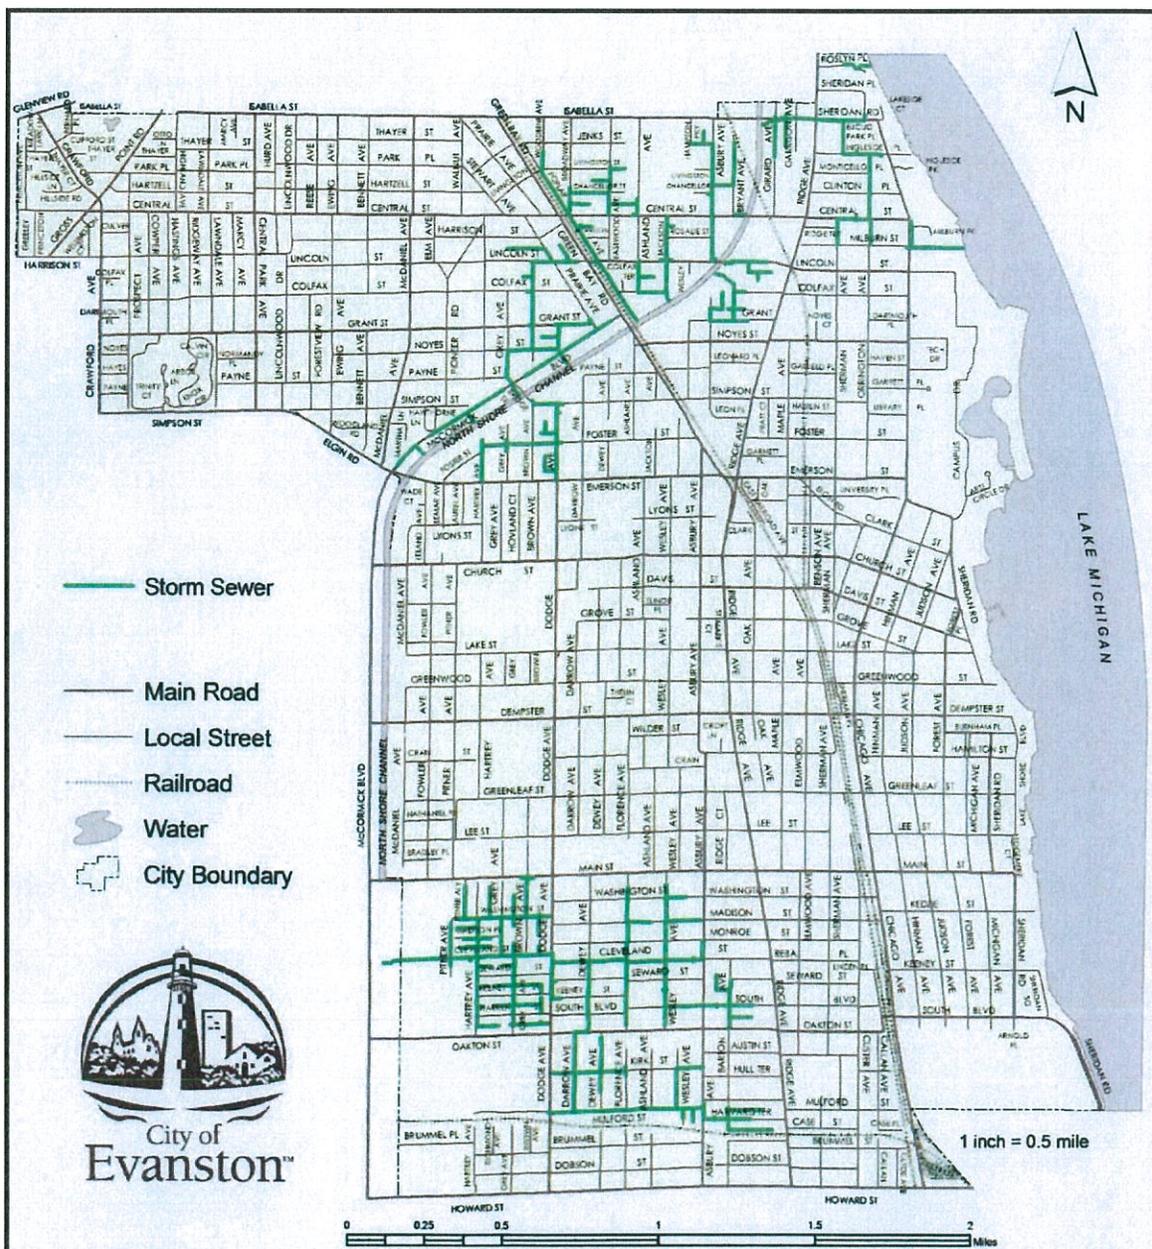


Sewer Mains

System Data and Maintenance*

Sewer Length by Type	Pipe Length (miles)				
	2011	2012	2013	2014	2015
Combined Sewer	143.60	143.78	143.93	143.85	144.30
Relief Sewer	51.51	51.78	52.65	52.82	53.54
Storm Sewer	16.21	16.21	16.31	16.31	16.29
Total Length	211.32	211.77	212.89	212.98	214.13

Sewer Installation and Maintenance	Pipe Length (feet)				
	2011	2012	2013	2014	2015
Installed (new)	424	239	1,682	0	2,782
Replaced	0	0	0	0	0
CIPP Rehabilitation (Lining)	6,997	8,850	15,995	12,059	11,330
Spot Repair	3,280	1,183	4,804	780	2,143
Clean - Hydroflush	247,195	242,791	180,309	136,679	110,419
Clean - Root Cut	17,543	5,372	7,657	14,412	39,987
Inspection - General	25,354	19,695	21,421	26,570	45,777
Inspection - Televised	81,502	83,942	78,022	69,805	50,300
Inspection - Storm-related**	2,070	0	1,981	971	530

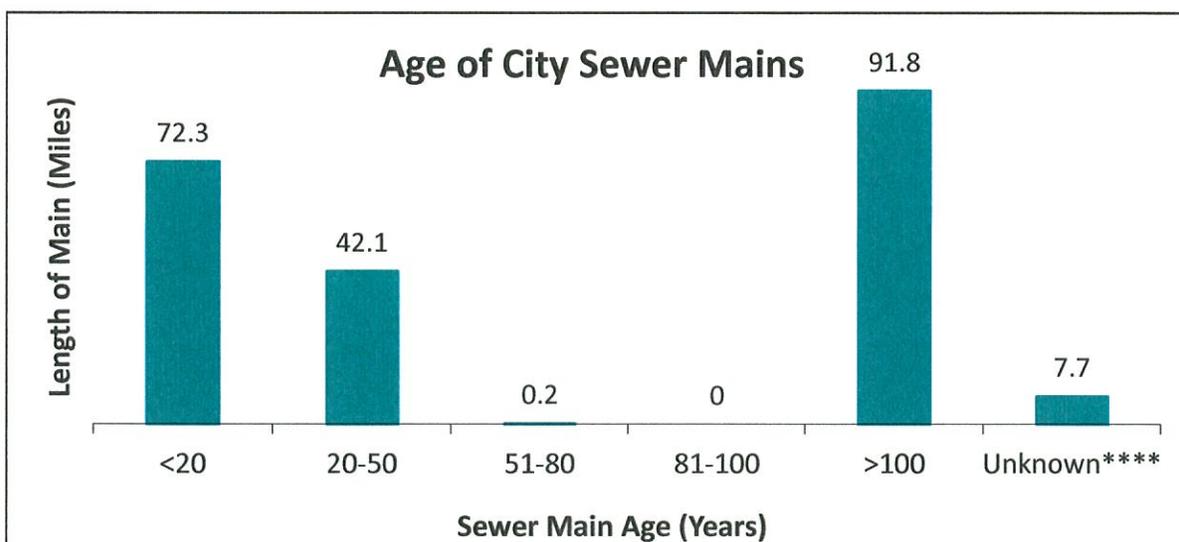

* All work performed by the Public Works Agency except CIPP Rehabilitation (Lining).

** Includes sewers installed as part of alley improvement projects.

*** Inspection of City sewer mains as a result of sewer surcharge during or after a wet weather event, and inspection of storm sewer outfalls into the North Shore Channel.

**** Mains of unknown age were installed prior to detailed record keeping on sewer installations.

Length of Sewer Mains

By Type and Diameter

Diameter	Combined Sewer		Relief Sewer		Storm Sewer	
	Feet	Miles	Feet	Miles	Feet	Miles
<6"	3,002	0.57	243	0.05	0	0.00
6"	644	0.12	0	0.00	0	0.00
8"	21,555	4.08	10,521	1.99	1,933	0.37
9"	124,280	23.54	7,229	1.37	1,031	0.20
10"	108,401	20.53	29,313	5.55	10,835	2.05
12"	225,299	42.67	25,493	4.83	9,861	1.87
14"	1,019	0.19	0	0.00	0	0.00
15"	92,591	17.54	5,903	1.12	5,249	0.99
16"	2,085	0.39	6,160	1.17	724	0.14
18"	61,918	11.73	16,581	3.14	7,695	1.46
20"	8,410	1.59	127	0.02	0	0.00
21"	15,052	2.85	2,747	0.52	1,910	0.36
22"	858	0.16	0	0.00	0	0.00
24"	21,405	4.05	46,372	8.78	15,959	3.02
27"	6,434	1.22	6,373	1.21	3,240	0.61
30"	6,973	1.32	19,107	3.62	3,913	0.74
33"	3,771	0.71	1,309	0.25	482	0.09
36"	19,757	3.74	18,386	3.48	6,730	1.27
39"	421	0.08	0	0.00	0	0.00
40"	377	0.07	0	0.00	0	0.00
42"	6,700	1.27	12,266	2.32	3,570	0.68
45"	1,029	0.19	0	0.00	0	0.00
48"	13,108	2.48	22,580	4.28	7,966	1.51
51"	1,104	0.21	0	0.00	0	0.00
54"	1,981	0.38	3,159	0.60	609	0.12
57"	784	0.15	0	0.00	0	0.00
60"	7,206	1.36	4,916	0.93	3,633	0.69
72"	4,077	0.77	11,640	2.20	0	0.00
78"	0	0.00	5,440	1.03	0	0.00
84"	0	0.00	88	0.02	0	0.00
96"	0	0.00	2,366	0.45	0	0.00
108"	0	0.00	5,025	0.95	0	0.00
113"	0	0.00	9,275	1.76	0	0.00
120"	0	0.00	7,340	1.39	0	0.00
Unknown	1,674	0.32	2,748	0.52	691	0.13
Totals	761,914	144.30	282,705	53.54	86,032	16.29

Total Sewer Main Length: 214.14 miles

Sewer Structures

System Data and Maintenance


Number of Sewer Structures	2011	2012	2013	2014	2015
Manholes	5,507	5,532	5,561	5,566	5,582
Inlets	2,902	2,927	2,973	2,974	3,018
Catch Basins	6,159	6,179	6,203	6,208	6,238
Total	14,568	14,638	14,737	14,748	14,838

Sewer Structure Installation & Maintenance	2011	2012	2013	2014	2015
Installed (new)	7	2	16	1	41
Replaced	12	39	5	21	18
Repair	96	133	87	55	73
Clean	2,428	4,109	2,732	3,181	3,262
Inspect - General	286	411	327	161	614
Inspect - Storm-Related*	835	479	1001	985	935

* Inspection of City drainage structures as a result of street or alley flooding during or after a wet weather event.

Breakdown of In-House Maintenance Costs*

Description	2011	2012	2013	2014	2015
Sewer Mains	\$616,921	\$413,919	\$449,960	\$355,398	\$344,407
Sewer Structures	\$474,164	\$615,415	\$423,665	\$353,667	\$547,051
Equip/Facility Maint.	\$208,299	\$161,460	\$176,489	\$87,884	\$162,452
Assist W&S Divisions	\$49,930	\$45,855	\$48,692	\$73,275	\$80,729
Snow & Ice Removal	\$132,370	\$31,396	\$66,675	\$243,207	\$68,538
Assist Contractors	\$8,847	\$18,240	\$39,542	\$18,681	\$16,637
Assist Other City Depts	\$29,093	\$57,269	\$13,569	\$35,943	\$17,107
Safety & Training	\$15,857	\$21,321	\$15,233	\$18,759	\$27,486
Miscellaneous	\$9,799	\$5,966	\$6,808	\$13,868	\$10,588
JULIE Locates	\$2,155	\$1,300	\$135	\$553	\$193
Total	\$1,547,437	\$1,372,141	\$1,240,768	\$1,201,233	\$1,275,188

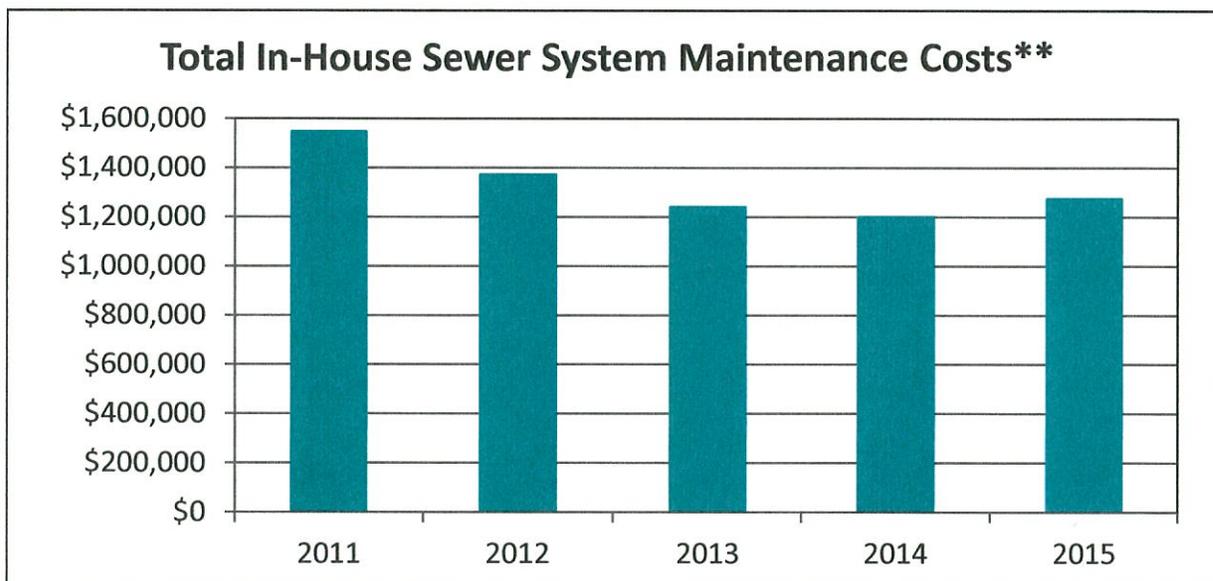

* All work completed by Public Works Agency staff unless otherwise noted.

** Costs fluctuate from year to year due to changes in maintenance needs and prioritization of repair projects.

Sewer Mains Rehabilitated (Lined)

The Public Works Agency manages an annual sewer improvement program, with the goal of rehabilitating at least 1.5 miles of combined sewer mains annually (minimum 1% annual system-wide renewal rate).

